



eco-ATWB-E

The Best Family of Closed Circuit Coolers to maximize water and energy savings

Eurovent-CTI
CERTIFIED


Ellipti-fin[®] coil
CROSSCOOL[™]
Technology



Environmentally Conscious Operation Featuring
Water & Energy Conserving Technology

ENVIRONMENTAL SOLUTIONS... CREATING A BETTER WORLD!

CERTIFIED EN ISO 9001



Mark owned by the Cooling Technology Institute

eco-ATWB-E



Since its founding in 1976, EVAPCO, Inc. has become a world-wide leader in supplying quality cooling equipment for thousands of customers in both the commercial and industrial markets.

EVAPCO's success has been the result of a continual commitment to product improvement, quality workmanship and a dedication to providing unparalleled service.



Our emphasis on research and development has led to many product innovations – a hallmark of EVAPCO through the years.

The ongoing R & D Program enables EVAPCO to provide the most advanced products in the industry – technology for the future, available today.


EVAPCO products are manufactured on five continents around the world and distributed through hundreds of factory authorized sales representatives.

Design and Construction Features

The new eco-ATWB-E line of Closed Circuit Coolers offers the same great design benefits and features as the eco-ATW but it has also been specifically designed to optimize both the evaporative (latent) and dry (sensible) modes of cooling simultaneously. This unique design joins an evaporative cooler and a dry cooler into one unit. The eco-ATWB-E utilizes the EVAPCO **Ellipti-fin** coil which features elliptical spiral fin technology to maximize the surface area available for heat transfer. This decreases water consumption and offers additional cost savings through reduced water make-up, blow-down, and chemical consumption. Evaporative cooling provides lower system operating temperatures and higher overall system efficiencies. The eco-ATWB-E is the ideal solution for: Reducing Water Consumption, Lower Energy Costs, High Dry Bulb Switchover, Super Low Sound Levels. **This new product is designed with IBC Compliant construction and Eurovent Certified and CTI Eurovent-CTI Certified.**

Easy to Service Motor Mount Design

- All normal maintenance can be performed quickly from outside the unit
- Designed for easy belt adjustment
- Extended lube lines for easy bearing lubrication
- If required, motor may swing to outside for easy removal



Water Saver Drift Eliminators

- New patented design reduces drift rate to < 0.001%
- Saves water and reduces water treatment cost
- Greater structural integrity vs. old style blade-type
- Recessed into casing for greater protection
- Drift rate certifications with Eurovent OM-14-2009



PVC Spray Distribution Header with ZM II™ Nozzles

- Large orifice nozzles prevent clogging (no moving parts)
- Nozzles are threaded into header at proper orientation
- Fixed position nozzles require zero maintenance
- Guaranteed for life



"Clean Pan" Basin Design

- Access from all four sides
- Large open area simplifies maintenance
- Basin may be inspected with pumps running
- Sloped basin design prevents sediment buildup, biological film and standing water



The Sage®

Water and Energy Conservation Control System

The only way to properly control and operate the eco-ATWB-E Closed Circuit Cooler is to provide as standard, the Sage® Water and Energy Conservation Control System. The Sage® is designed to optimally control the fan motor(s) and the pump motors of the unit. The Sage® will efficiently reject the building load using the minimal amount of water and energy.

- Sophisticated control system that measures & analyses water inlet & out-let temperatures and the ambient dry bulb to minimize water consumption
- Variable frequency drive controls for fan motor(s)
- Maximizes water and energy savings



Advanced Design Smooth Flow Fans

- Totally Enclosed Fan Motors assures long life
- Power-Band Belts for Better Lateral Rigidity
- Advanced Design Aluminum Fan Blades
- Non-corroding Cast Aluminum Sheaves
- Heavy-Duty Fan Shaft Bearings with L-10 life of 75,000 - 135,000 hrs
- All Other Components Corrosion Resistant Materials



Eurovent-CTI Certified
Refer to page 25

Low Sound Options available
Refer to page 17




Super Low Sound Fan (optional)

- Extremely wide sloped fan blades for sound sensitive applications
- One piece molded heavy duty construction
- 9-15 dB(A) sound reduction

Ellipti-fin® Coil
Featuring Elliptical Spiral Fin Coil Technology

Introducing the Most Efficient Closed Circuit Cooler Coil in th HVAC industry! The Ellipti-fin® provides:

- All coil rows feature patent pending finned Thermal-Pak® elliptical tube design
- Lower airflow resistance than typical finned round tubes
- Increased Evaporative and Dry Cooling efficiency
- Features EVAPCO's exclusive **CROSSCOOL™** tube enhancement for greater internal heat transfer.

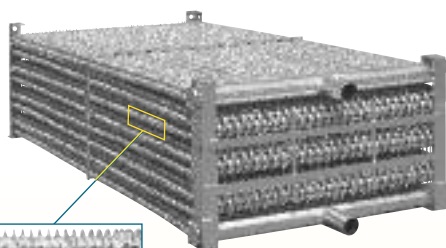

IBC Compliant Design
Refer to page 23



Partition Panel
A water tight partition spans from the fan section of the unit down to the basin. This partition separates the two coils and ensures water does not contact the dry coil when the unit is operating in the water efficient mode.

Multiple Water Distribution Systems
Each coil in this unit features its own water distribution system. This allows each coil to operate in a mode independent of the other coil.

WST Air Inlet Louvers (Water and Sight Tight)

- Easily removable for access
- Improved design to keep sunlight out—preventing biological growth
- Keeps water in while keeping dirt and debris out (U.S. Patent No. 7927196)




Louver Access Door

- Hinged access panel with quick release mechanism
- Allows easy access to perform routine maintenance and inspection of the make-up assembly, strainer screen and basin
- Available on larger models



Easy Field Assembly

- A new field assembly seam design which ensures easier assembly and reduced potential for field seam leaks
- Self-guided channels guide the fan casing section into position improving the quality of the field seam
- Eliminates up to 66% of fasteners (Patent Pending)

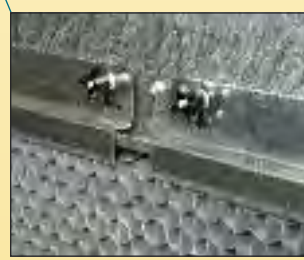

† Mark owned by the Cooling Technology Institute

eco-ATWB-E

DESIGN FEATURES

Principle of Operation

Dry Mode

(Sensible Heat Transfer)

In the dry mode, the recirculating spray pumps are turned off (Fan on, Pump A & B off). The process fluid enters the eco-ATWB-E cooler through the top coil connection and circulates through the coil with the Fan On. Heat from the process fluid is dissipated to the atmosphere by sensible heat transfer through the tube walls to the air passing over the coils. The coils are finned to promote optimal airflow over the coil and to maximize heat transfer area. Air is drawn over the finned coils by the fan drive system. The process fluid is then returned to the heat source via the bottom coil connection. This mode of operation eliminates water consumption when the dry bulb temperature is favorable.

Water Efficient Mode




(Evaporative and Sensible Heat Transfer)

The joint wet and dry operation mode provides water savings as well as low approach temperatures. In this joint mode of operation, the fan is on and the process fluid enters the coils through the top coil connections (Fan on, Pump A on, Pump B off). Recirculating pump B is turned off and coil B rejects a portion of the heat load to the atmosphere through the tube and fin walls to the air passing over the coils using sensible heat transfer. Pump A is left on where heat from the process fluid is transferred through the coil tubes to the water cascading downward over coil A. This mode of operation minimizes the amount of water used while maintaining the cooling capacity required. The cooled fluid then returns to the process via the bottom coil connection.

Evaporative Mode

(Latent Heat Transfer)

In the evaporative mode, the process fluid enters the cooler through the top coil connections and circulates through the finned coils. With both pumps on, the heat from the process fluid is transferred through the coil tubes to the water cascading downward over the coils while simultaneously air is drawn upward over the coil opposite the water flow using the fan drive system (Fan on, Pump A & B on). A small portion of the water is evaporated to dissipate the heat to the atmosphere in a latent heat transfer. This mode of operation provides fan energy savings and lower leaving water temperatures by utilizing evaporative cooling.

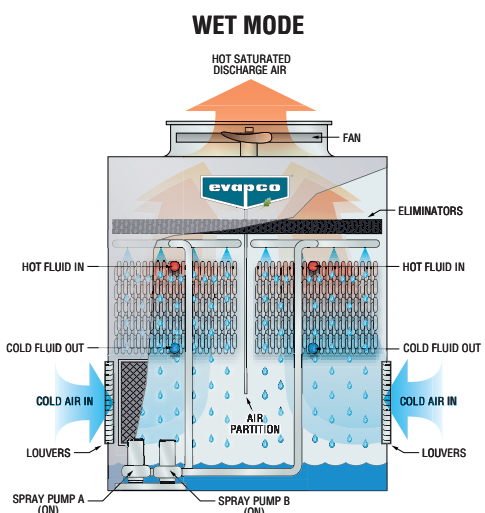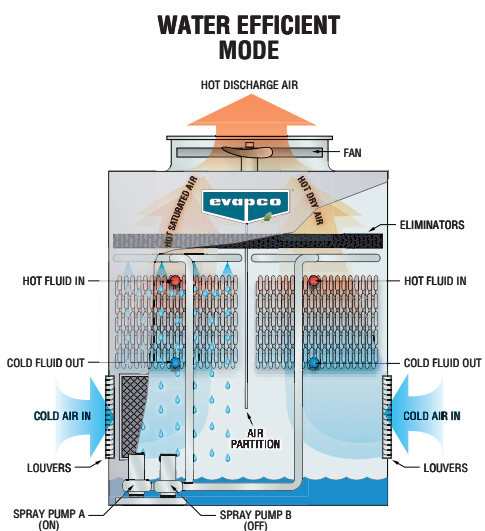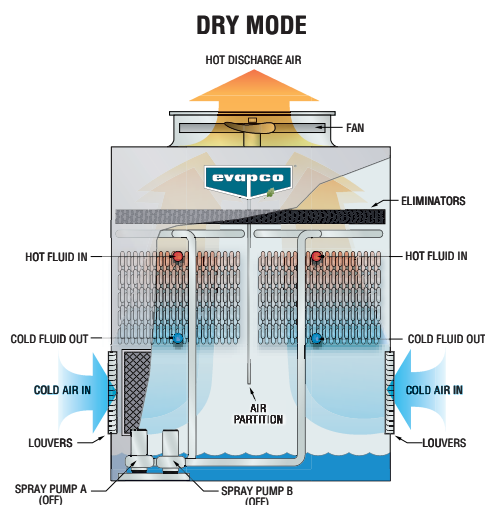

DESIGN FEATURES

eco-ATWB-E

eco-ATWB-E Operating Benefits

The eco-ATWB-E maintains all of the advantages of the eco-ATW with the additional benefit of enabling simultaneous wet and dry operation. The unique **Water Efficient Mode** of the eco-ATWB-E allows for a portion of the heat load to be rejected through both evaporative cooling AND dry cooling, even at high ambient temperatures, this further increases your ability to save water and offers additional associated cost savings through reduced water make-up, blow-down and chemical consumption. The eco-ATWB-E provides an ideal solution for applications where minimizing both energy and water consumption is critical.

Depending on the optimum eco-Cooler you select for your job, one can operate 100% wet, 100% dry or simultaneously Wet & Dry in the **Water Efficient Mode**, offering unique advantages in freezing climates, higher temperature industrial cooling applications where 100% evaporative cooling is not always favorable.

eco-ATWB-E Operational Savings example:

Consider an industrial application in Munich (Germany), where the unit is required to reject a constant heat load of 740 kW with 30 l/s of water entering at a temperature of 32°C and a leaving temperature of 26°C. The process operates 24 hours a day 7 days a week. The eco-ATWB-E is compared to:

- **ESWA 96-33J-2** – an evaporative cooler without dry cooling capability
- **ATW 120-4K-2** – an induced draft counter-flow cooler capable of some dry operation

Model Attribute Comparison

| | eco-ATWB-E 10-5112-Z | ATW 120-4K-2 | ESWA 96-33I-2 |
|------------------|-------------------------|-----------------|------------------|
| Fan Motor (kW) | 7,5 | 15 | 7,5 |
| Pump Motor (kW) | (2) 1.5 | 4 | 5,5 |
| Box size (m x m) | 3.0 x 3.6 | 3.0 x 3.6 | 2.4 x 3.6 |
| Weight (kg) | 13130 | 10120 | 6665 |


Generally the eco-coolers eco-ATWB-E require lower total installed kW than ATW and ESWA with consequent energy savings.

Dry Mode of Operation Comparison

| | eco-ATWB-E 10-5112-Z | ATW 120-4K-2 | ESWA 96-33I-2 |
|--------------------------|-------------------------|-----------------|------------------|
| % dry operation hours | 18,9 | 4 | 0 |
| % hybrid operation hours | 62,9 | 0 | 0 |
| % wet hours | 18,2 | 96 | 100 |

With the increased dry cooling efficiency of the eco-ATWB-E and the use of the Sage3® Water and Energy Conservation Control System, the eco-ATWB-E is able to operate dry or hybrid mode for more than 80% of the year:

eco-ATWB-E vs ATW and ESWA

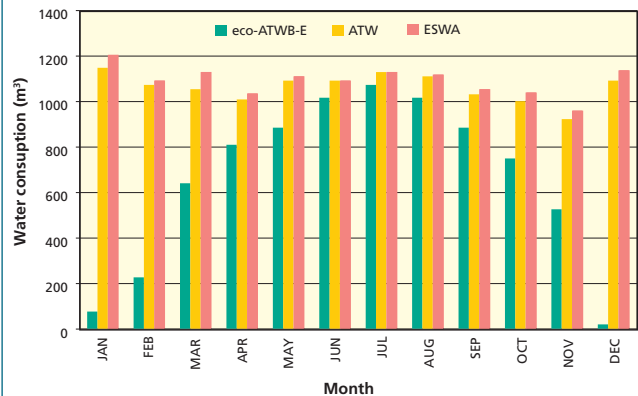

With very interesting savings associated with water usage.

Annual Water Cost Comparison

| | eco-ATWB-E 10-5112-Z | ATW 120-4K-2 | ESWA 96-33I-2 |
|---|-------------------------|-----------------|------------------|
| Total Annual Water Usage (m³) * | 7951 | 12807 | 13155 |
| Annual m³ Water Savings eco-ATWB-E vs. ATW / ESWA (%) | - | 38,0% | 39,6% |
| Annual Water Savings eco-ATWB-E vs. ATW / ESWA (€) ** | - | 17000, € | 18300, € |

* Based on 3 cycles of concentration
 ** 3.5 € / m³ (water-treatment-sewer)

eco-ATWB-E

SAGE SYSTEM

EVAPCO's Sage ... Water and Energy



The EVAPCO eco-ATWB-E closed circuit coolers utilize the Sage3™ water and energy conservation control system which controls Dry & Evaporative modes of operation. The control system operates by measuring and analyzing water inlet and outlet temperature simultaneous with ambient dry bulb monitoring in order to minimize the evaporative cooling mode of operation and to save system water. The Sage3™ can also be programmed to operate with a water savings or energy savings priority. Sage3™ is supplied as standard with eco-ATWB-E.

The Sage Controller features a IP65 enclosure with CE approval. The panel also includes a 10" touch screen operator interface with color display and a Modbus 485* data port for communication with the building automation system. **The data points are: Inlet Temperature, Outlet Temperature, Dry Bulb Temperature, Basin Water Temperature Sensor, Fan Run Time, Pump Run Time, VFD Speed, Fan Motor Status – On/Off, Fan RPM, Pump Status – On/Off.**

Standard Control Items

- A MODBUS 485* Port for the Building Automation System
- Programmable Logic Control
- Fluid Inlet Temperature Sensor(s)
- Fluid Outlet Temperature Sensor(s)
- Basin Temperature Sensor(s)
- Ambient Dry Bulb Sensor(s)
- Variable frequency drive(s) For Fan Motor(s)
- Recirculating Pump Motor Starter(s).
- Main Disconnect
- Manual Bypass
- DC power supply for the PLC and instrumentation.
- Heater Package Controls w/ Contactor with Overload Protection
- Control Power Transformer
- 3-Probe Electronic Water Level Control Package
- High Water Level Alarm Contact(s)
- Low Water Level Alarm Contact(s)
- Fan Motor: Space Heater Control(s)

Control for Optional Accessories

- Discharge Hood Damper Controls
- Vibration Switch Controls



SAGE SYSTEM

ECO-ATWB-E

Conservation Control System


HMI Panel Display

Sage® Control Panel is provided with a 10" touch screen operator interface with a color display. This allows for easy viewing and control at the panel.



Easy-to-use Touch Screen Navigation


The panel boasts an easy to navigate menu which will allow the user to control each cell independently from other units and gather useful run time information at the unit.

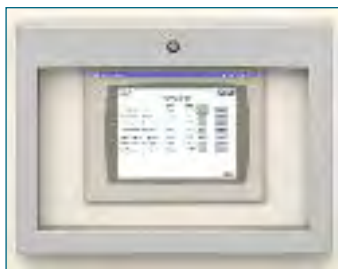

Alarm Setpoints Screen



Plan View Screen

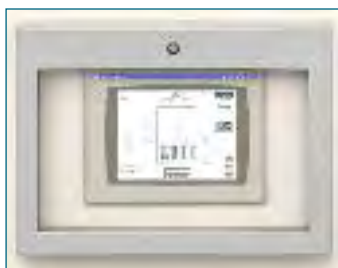

End View Screen



Window Enclosure

The display screen is encased by a window enclosure. This enclosure protects the HMI display from the elements.

Electric Water Level Control Package

When a Sage Panel is provided, a 3-probe Electronic Water Level Controller is standard. In addition to controlling the make-up valve, this controller contains one probe that can be utilized as low water cut off for the spray pump and also be used as a safety device, shutting off the pump if the water level becomes too low. High/Low water level alarm probes are std, too.


Temperature Sensors

Four separate temperature data points are monitored with this package.

- Inlet Water Temperature Sensor
- Outlet Water Temperature Sensor
- Dry Bulb External Air Temperature Sensor
- Water Basin Temperature Sensor

Enclosure Temperature Control

The panel enclosure includes an intake and an exhaust ventilation fan. When the enclosure temperature rises to a predetermined set point, the exhaust fans are activated. The enclosure also contains a heater. The heater eliminates the drastic temperature changes which could create condensation inside of the enclosure.



Fan



Heater

**Optional Data Ports May Be Available. Please Contact Your Local Sales Representative.*

eco-ATWB-E

DESIGN FEATURES

EVAPCOAT Corrosion Protection System

EVAPCO, long known for using premium materials of construction, has developed the ultimate system for corrosion protection in galvanized steel construction – the EVAPCOAT Corrosion Protection System. Marrying corrosion free materials with heavy gauge mill hot-dip galvanized steel construction to provide the longest life product with the best value.


The Evapcoat Corrosion Protection System consist of:

- **Z-725 Mill Hot-Dip Galvanized Steel Construction**

Mill hot-dip galvanized steel has been successfully used for over 25 years for the protection of evaporative coolers against corrosion. There are various grades of mill galvanized steel each with differing amounts of zinc protection. EVAPCO has been a leader in the industry in developing heavier galvanizing, and was the first to standardize on Z-600 mill hot-dip galvanized steel. Now, EVAPCO is, once again, increasing the level of corrosion protection by being the first and only manufacturer in Europe to use Z-725 mill hot-dip galvanized steel.

Z-725 designation means there is a minimum of 725 g of zinc per m² of surface area present on the steel. Z-725 is the heaviest level of galvanizing available for manufacturing evaporative coolers and has over 2.5 times more zinc protection than competitive designs using Z-275 steel. With Z-725 mill hot-dip galvanized steel construction, EVAPCO provides galvanized steel panels with corrosion protection that approaches the level of the hot-dip galvanized heat exchanger coils.

During fabrication, all panel edges are coated with a 95% pure zinc-rich compound for extended corrosion resistance.

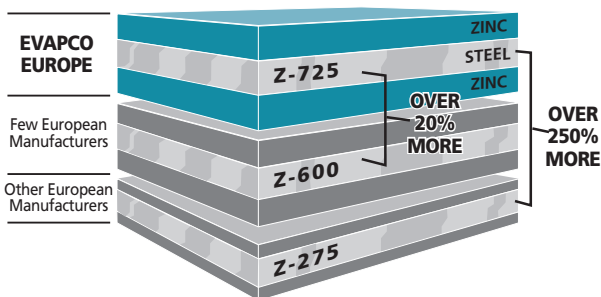

- **Type 304 Stainless Steel Strainers**

Subjected to excessive wear and corrosion, the sump strainer is critical to the successful operation of the cooler. EVAPCO uses only stainless steel for this very important component.

- **PVC Air Inlet Louvers**

The innovative design uses corrosion free materials while effectively eliminating splash out and reducing the potential for algae formation inside the cooler.

- **PVC Drift Eliminators**

The final elements in the upper part of the cooler are moisture eliminators which strip the entrained water droplets from the leaving air stream.

EVAPCO eliminators are constructed entirely of inert, corrosion-free PVC. This PVC material has been specially treated to resist damaging ultraviolet light. The eliminators are assembled in easily handled sections to facilitate removal thereby exposing the upper portion of the unit and water distribution system for periodic inspection.

- **PVC Water Distribution System, ZM Spray Nozzle**

The fixed position ZM Spray Nozzles are mounted in corrosion-free PVC water distribution pipes. Together, these elements combine to provide unequaled coil coverage, scale prevention and make the industries best performing non-corrosive, maintenance-free water distribution system.

- **Totally Enclosed Motors**

EVAPCO uses totally enclosed motors for all fan and pump motors as standard. These superior motors help to assure longer equipment life without motor failures, which result in costly downtime.

- **Alternate Materials of Construction**

EVAPCO induced draft coolers have a modular design which allows for specific areas to be enhanced for increased corrosion protection. For particularly corrosive environments, EVAPCO coolers are available with Stainless Steel construction for the basin and/or casing.

- **Stainless Steel Welded Basin**

The basin area of a cooler is often subjected to high concentrations of impurities and silt. In addition to the EVAPCOAT Corrosion Protection System, EVAPCO offers optional stainless steel construction for superior corrosion resistance. This option provides Type 304 or Type 316 stainless steel for the entire basin section - including the support columns and air inlet louver frames.

NOTE: Closed Circuit Coolers should only be used on sealed, pressurized systems. Continual aeration of the water in an open system can cause corrosion inside the tubes of the cooler leading to premature failure.

DESIGN FEATURES

eco-ATWB-E

Belt Drive Units - 2.3 m, & 2.4 m Wide Models

eco-ATWB-E 9-3G8 to eco-ATWB-E 8-6K21

The fan motor and drive assembly on these units are designed to allow easy servicing of the motor and adjustment of the belt tension from the exterior of the unit. The T.E.F.C. fan motor is mounted on the outside of these models.



External Motor Mount (with optional ladder)


A large hinged access door with a "quick release" latch provide access to the fan section for maintenance.

NOTE: the sloped access ladder is available on all eco-ATWB-E models. Please check conformity with local legislation before application.

Belt Drive Units - 3 m & 3.6 m Wide Models

eco-ATWB-E 10-3I-12 to eco-ATWB-E 12-6P-20

Designed as the ideal replacement cooler, these models provide both cost effective and energy efficient alternatives to obsolete centrifugal fan designs. The 3 m wide plan areas are also well suited for new installations and provide more layout flexibility. The unique belt drive design features are detailed below.

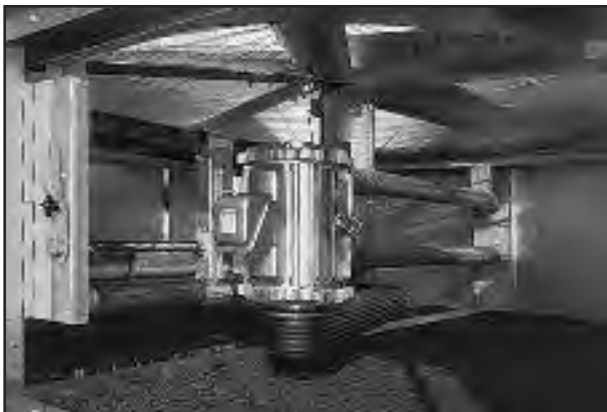

Motor Base Assembly

The fan motor and drive assembly is designed to allow easy servicing of the motor and adjustment of the belt tension from the exterior of the unit. The T.E.A.O. fan motor is located inside the fan casing on a rugged heavy duty motor base. The innovative motor base also features a unique locking mechanism for a positive adjustment.

The motor base is designed to swing out through a very large 1.3 m² access opening. This allows for easy servicing of the motor.



Motor Access

Power- Band Drive Belt: The Power-Band is a solid-back, multigroove belt system that has high lateral rigidity. The belt is constructed of neoprene with polyester cords. The drive belt is designed for 150 percent of the motor nameplate kW for long life and durability.

Fan Shaft Bearings: The fan shaft bearings in eco-ATWB-E units are specially selected for long, trouble-free life. They are rated for an L-10 life of 75,000 to 135,000 hours and are the heaviest pillow block bearings available.

Aluminum Alloy Pulleys: Fan pulleys are constructed of corrosion free aluminum for long life. The aluminum also helps belts last longer.

eco-ATWB-E

DESIGN FEATURES


Water Management High Efficient Water Saver Drift Eliminators

An extremely efficient drift eliminator system is standard on EVAPCO coolers. The patented system removes entrained water droplets from the air stream to limit the drift rate to less than 0.001% of the recirculating water rate. With a low drift rate, EVAPCO coolers save valuable water and water treatment chemicals. The drift eliminators are constructed of an inert polyvinyl chloride (PVC) plastic material which effectively eliminates corrosion of these vital components. They are assembled in sections to facilitate easy removal for inspection of the water distribution system.



Superior WST Air Inlet Louver and Screen Design

EVAPCO's patented WST Inlet Louvers keep water in and sunlight out of the basins of induced draft products. The unique non-planar design is made from light-weight PVC sections which easily fit together and have no loose hardware, enabling easy basin access.

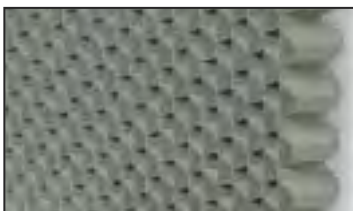


Inlet Louver Material

Developed with computational fluid dynamics (CFD) software, the louver's air channels are optimized to maintain fluid dynamic and thermodynamic efficiency and block all line-of-sight paths into the basin eliminating splash-out; even when the fans are off. Additionally, algae growth is minimized by blocking all sunlight.

The combination of easy basin access, no splash-out and minimized algae growth saves the end user money on maintenance hours, water consumption and water treatment costs.

"Clean Pan" Basin Design

EVAPCO coolers features a completely sloped basin from the upper to lower pan section. This "Clean Pan" design allows the water to be completely drained from the basin. The cooler water will drain from the upper section to the depressed lower basin section where the dirt and debris can be easily flushed out through the drain. This design helps prevent buildup of sedimentary deposits, biological films and minimizes standing water.

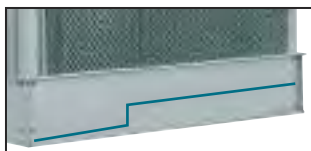

Sloped Basin

Maintenance Free ZMII® Spray Nozzle Water Distribution System

EVAPCO'S Zero Maintenance ZMII® Spray Nozzle remains clog-free while providing even and constant water distribution for reliable, scale-free evaporative cooling under all operating conditions.


The heavy duty nylon ZMII® Spray nozzles have a 33 mm diameter opening and a 38 mm splash plate clearance. Furthermore, the fixed position ZMII® nozzles are mounted in corrosion-free PVC water distribution pipes. Together, these elements combine to provide unequalled coil coverage and scale prevention, and make the industry's best performing non-corrosive, maintenance-free water distribution system.




ZMII® Nozzle

Cooling Coil


The new eco-ATWB-E Closed Circuit Cooler utilizes Evapco's patent pending **Ellipti-fin** coil design which assures even greater operating efficiency. The elliptical tube design allows for closer tube spacing, resulting in greater surface area per plan area than round-tube coil designs. In addition, the revolutionary **Ellipti-fin** design utilizes elliptical spiral fin coil technology and has lower resistance to airflow than typical finned coil designs. This permits greater water loading, making the new **Ellipti-fin** coil the most effective design available.



Thermal-Pak® Coil by EVAPCO



Round Tube Coil by Others



The coils are manufactured from high quality internally enhanced **CROSScool™** carbonsteel tubing following the most stringent quality control procedures. Each circuit is inspected to ensure the material quality and then tested before being assembled into a coil and encased in a steel framework. Finally, the assembled coil is pneumatically tested in accordance with the "Pressure Equipment Directive" - PED 97/23 EC.

After fabrication, to protect the coil against corrosion, the entire assembly is hot-dip galvanized.

OPTIONAL EQUIPMENT

eco-ATWB-E

Two Speed Motors

Two speed fan motors can provide an excellent means of capacity control. In periods of lightened loads or reduced wet bulb temperatures, the fans can operate at low speed, which will provide about 60% of full speed capacity, yet consume only about 15% of the power compared with high speed. In addition to the energy savings, the sound levels of the units will be greatly reduced at low speed.


Inverter Duty Motors

Inverter Duty motors are available for cooler applications which utilize variable frequency drive systems for capacity control. Inverter Duty motors offer totally enclosed premium efficiency construction which is designed for variable frequency drive applications.

Note: Other special motor configurations are available to meet specific proper requirements. Contact your local EVAPCO sales representative for application assistance and motor availability.


Remote Sump Configuration

For units operating in areas where temperatures may be very low, or where low temperatures may occur during periods when the unit is not operating, a sump located inside the building is the preferred means of ensuring that the basin water will not freeze. For these applications, the cooler will be supplied without the spray pump, suction strainers and all associated piping, but with an oversize bottom outlet.

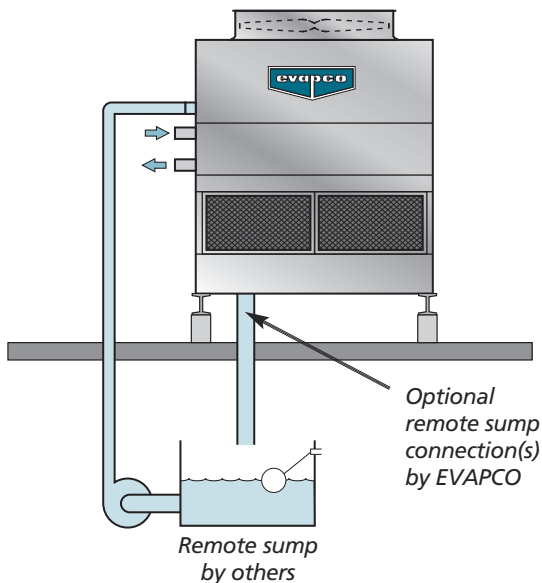


Basin Heater Package

If a remote sump configuration is not practical, electric basin heater packages are available to help prevent freeze-up of the basin water. The packages include electric heater elements and a combination with thermostat and low water cut-off. (Consult EVAPCO for heater size and application)

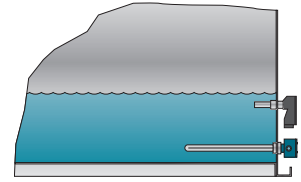

Electric Water Level Control

Evaporative coolers may be ordered with an electric water level control in lieu of the standard mechanical float and make-up assembly. This package provides accurate control of water levels and does not require field adjustment.

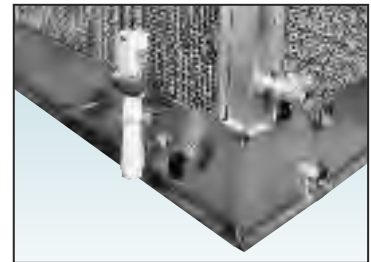

Multiple Circuit Coils

Coolers may be supplied with multiple circuit coils to match various system requirements such as split systems.

Self Supporting Service Platforms

Coolers are available with self-supporting service platforms that include access ladders which are designed for easy field installation. This option offers significant savings in comparison to field constructed, externally supported catwalks. The EVAPCO service platform option will be installed in front of the fan access doors.

Motor Davit

In the event that a fan and/or fan motor should need to be replaced, a motor davit is available from which a chain fall can be mounted to easily lower the motor/fan to the ground.



eco-ATWB-E Cooler with Optional Service Platform and Motor Davit

eco-ATWB-E

APPLICATION

Design

Evapco units are of heavy-duty construction and designed for long trouble-free operation. Proper equipment selection, installation and maintenance is, however, necessary to ensure full unit performance. Some of the major considerations in the application of a cooler are presented below. For additional information, please contact the factory.

Air Circulation

It is important that proper air circulation be provided. The best location is on an unobstructed roof top or on ground level away from walls and other barriers. Those closed circuit coolers located in wells, enclosures or adjacent to high walls must be properly located to avoid the problems associated with recirculation. Recirculation raises the wet bulb temperature of the entering air causing the water temperature to rise above the design. For these cases, the discharge of the fan should be located at a height even with the adjacent wall, thereby reducing the chance of recirculation. For additional information, see the Evapco Equipment Layout Manual.

Good engineering practice dictates that the closed circuit cooler discharge air not be directed or located close to or in the vicinity of building air intakes.

Piping

Cooler piping should be designed and installed in accordance with generally accepted engineering practices. The piping layout should be symmetrical on multiple unit systems, and sized for a reasonably low water velocity and pressure drop.

The standard closed circuit cooler is recommended only on a closed, pressurized system. The piping system should include an expansion tank to allow for fluid expansion and purging air from the system.

Note: Closed Circuit Coolers should never be used on an open system. Continual aeration of the water in an open system can cause corrosion inside the tubes of the cooler leading to premature failure.

The piping system should be designed to permit complete drainage of the heat exchanger coil. This will require a vacuum breaker or air vent to be installed at the high point and a drain valve installed at the low point of the piping system. Both must be adequately sized.

All piping should be securely anchored by properly designed hangers and supports. No external loads should be placed upon the cooler connections, nor should any of the pipe supports be anchored to the cooler framework.

Recirculating Water System

The surest way to protect the recirculating water system from freezing is with a remote sump. The remote sump should be located inside the building and below the unit. When a remote sump arrangement is selected, the spray pump is provided by others and installed at the remote sump. All water in the closed circuit cooler basin should drain to the remote sump when the spray pump cycles off. Refer to page 11 for concept illustration.

Other freeze protection methods are available when a remote sump is not feasible. Electric pan heaters, steam

or hot water coils can be used to keep the pan water from freezing when the unit cycles off. Water lines to and from the unit, spray pump and related piping should be heat traced and insulated up to the overflow level in order to protect from freezing.

Freeze Protection

If the units are installed in a cold climate and operated year-round, freeze protection must be provided for the heat exchanger coil in the unit as well as for the recirculating water system.

| eco-ATWB-E | std coil(s) | series flow coil(s) |
|------------|-------------|---------------------|
| Width (mm) | l/s | l/s |
| 2283 | 10,1 | 5,1 |
| 2388 | 10,1 | 5,1 |
| 2991 | 11,9 | 6,0 |
| 3607 | 14,7 | 7,4 |

Heat Exchanger Coil

The simplest and most foolproof method of protecting the heat exchanger coil from freeze-up is to use a glycol solution. If this is not possible, an auxiliary heat load must be maintained on the coil at all times so that the water temperature does not drop below 10°C when the cooler is shut down. Also, a minimum recommended flow rate must be maintained.

Maintaining the Recirculated Water System

The heat rejection in a condenser is accomplished by the evaporation of a portion of the recirculated spray water. As this water evaporates, it leaves behind all of its mineral content and impurities. Therefore, it is important to bleed-off an amount of water equal to that which is evaporated to prevent the build-up of these impurities. If this is not done, the mineral or the acidic nature of the water will continue to increase. This will ultimately result in heavy scaling or a corrosive condition.

Bleed-off

Each unit supplied with a pump mounted on the side is furnished with a clear bleed line for visual inspection and a valve which, when fully open, will bleed-off the proper amount of water. If the make-up water supplying to the unit is relatively free of impurities, it may be possible to cut back the bleed, but the unit must be checked frequently to make sure scale is not forming. Make-up water pressure should be maintained between 140 and 340 kPa.

APPLICATION

eco-ATWB-E

Water Treatment

In some cases the make-up water will be so high in mineral content that a normal bleed-off will not prevent scaling. In this case, water treatment will be required and a reputable water treatment company familiar with the local water conditions should be consulted. Units constructed of galvanized steel operating with circulating water having a pH of 8,3 or higher will require periodic passivation of the galvanized steel to prevent the formation of "white rust". Any chemical water treatment used must be compatible with the galvanized construction of the unit. If acid is used for treatment, it should be accurately metered and the concentration properly controlled. The pH of the water should be maintained between 7 and 8,8. Batch chemical feeding is not recommended because it does not afford the proper degree of control. If acid cleaning is required, extreme caution must be exercised and only inhibited acids recommended for use with galvanized construction should be used.

Control of Biological Contamination

Water quality should be checked regularly for biological contamination. If biological contamination is detected, a more aggressive water treatment and mechanical cleaning program is required. The water treatment program should be performed in accordance with local legislation and in conjunction with a qualified water treatment company. It is important that all internal surfaces be kept clean of accumulated dirt or sludge. In addition, the drift eliminators should be kept in good operating condition to minimize water from exiting the evaporative cooling unit in the discharge air. To minimize the risk of biological contamination, at initial start up or after an extended shut down, it is recommended that the cooler be properly treated. Clean all debris such as leaves and dirt from the unit. Completely fill the basin to the overflow level with fresh water. Initiate a biocide water treatment or shock treatment program prior to operating the unit. It is preferable that all such procedures be conducted or supervised by a water treatment specialist.

FM Approval



FM (Factory Mutual) Global is a mutual insurance company, which evaluates hazards and recommends improvements to property to reduce risks if a disaster like fire occurs.

EVAPCO's eco-ATWB-E closed circuit cooler can be executed to meet the FM approval standard.

To be in compliance with this standard the closed circuit coolers are improved with the following modifications:

- Water distribution system will be constructed out of galvanized steel for single cell units and out of PVC for multi cell units. Nozzles remain ABS plastic.
- Special full scale tested and approved PVC louver and eliminator material.
- Internal partition walls between cells and louver screens to avoid fire propagation.
- Air inlet louvers are provided with 1" x 1" hot dipped galvanized or stainless steel screens in front of the PVC air inlet material.
- Units with louvers more than 4' tall are provided with galvanized or stainless steel fire-walls which extend out from the unit 12" and are attached to the vertical supports between adjoining cells.
- Increased thickness of steel construction panels to improve fire resistance.
- Aluminum axial fans on single cell units, SLSF only on multi cell units for redundancy.

Some Useful Manuals available on EVAPCO Web-site



APPLICATIONS

eco-ATWB-E

APPLICATION

Technical Support Services

EVAPCO's evapSelect™ Equipment Selection Program

EvapSelect™ is a Web based computer selection program which allows the design engineer to choose EVAPCO models and optimize unit selections. The program allows the engineer to evaluate the equipment's thermal performance, space, energy requirements and water consumption. Once the model is selected and optional equipment features are inserted, the engineer may output a complete specification **AND** a unit drawing from this program.

The software is designed to provide the user with maximum flexibility in analyzing the various selection parameters while in a friendly and familiar Windows format.

The EvapSelect™ software is available to all consulting engineering offices and design-build contractors. The programs are distributed through the local EVAPCO sales representative or the EVAPCO offices.



EVAPCO's Website

Log on to EVAPCO's new and improved website <http://www.evapco.eu> for expanded product information. Product literature, Rigging and Maintenance Instructions are all accessible online from your computer.

The EvapSelect™ Equipment Selection Software program may be accessed using Microsoft Internet Explorer after contacting your local EVAPCO sales representative. Users may make Requests for Quotation through the website or by e-mailing EVAPCO at this address:


evapco.europe@evapco.eu

With the EvapSelect™ program, equipment selections, written specifications, unit drawing files and EVAPCO on-line information are readily available from the comfort of your own office!

APPLICATION


eco-ATWB-E

Some application ...

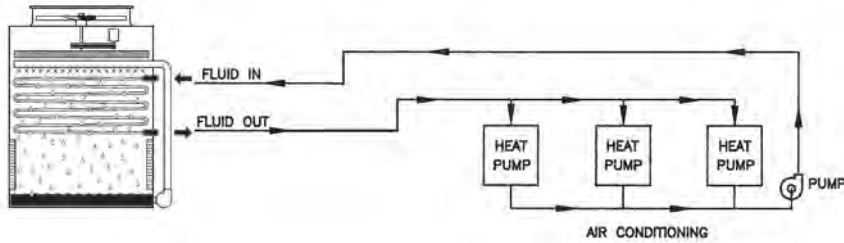


Air Conditioning

- Unitary Heat Pump Systems
- Computer Room Cooling
- Refrigeration Supplement

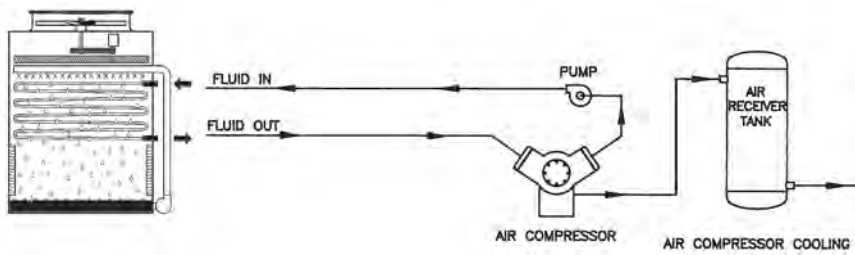


Manufacturing

- Air Compressors
- Plastic Mold Machines
- Transformers
- Engines

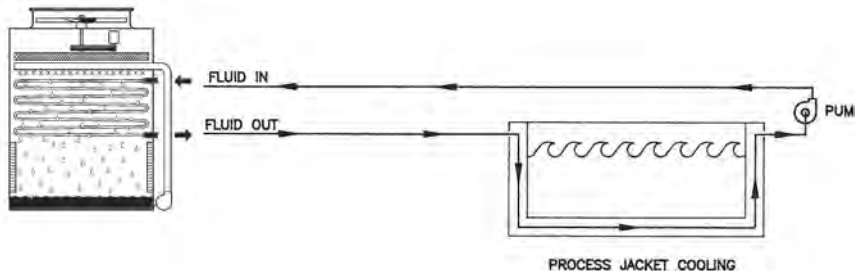

Steel Mills & Foundries

- Quench Tanks
- Rolling Mills
- Induction Furnaces
- Continuous Casters

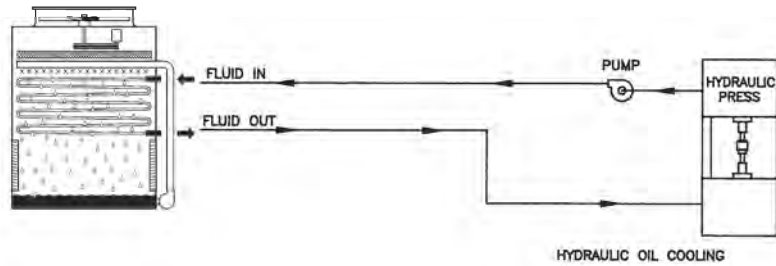

Industrial Fluids

- Hydraulic Oils
- Plating Solutions
- Quench Oils

eco-ATWB-E

Notes:

eco-ATWB-E



Ultra Quiet Closed Circuit Coolers

The New EVAPCO eco- Coolers eco-ATWB-E are now available with four (4) equipment options to reduce the overall sound generated from the side or top.

Each option provides various levels of sound reduction and can be used in combination to provide the lowest sound level.



Ultra Quiet operation for induced draft counterflow Closed Circuit Coolers

SOUND

eco-ATWB-E

ADVANCED TECHNOLOGY LOW SOUND SOLUTIONS

Super Low Sound Solution for Sound Sensitive Applications



Family of Super Low Sound Fans

The Super Low Sound Fan

Reduced Sound Levels versus Model eco-ATWB-E Standard Fan


EVAPCO's Super Low Sound Fan on the eco-ATWB-E Closed Circuit Coolers utilizes an extremely wide chord blade design applied for sound sensitive applications where the lowest sound levels are desired. The fan is one piece molded heavy duty FRP construction utilizing a forward swept blade design. The Super Low Sound Fan reduces sound levels 9 to 15 dB(A) compared to the Model ATW standard fan.

Improved Sound Quality versus Model eco-ATWB-E Standard Fan

The SUPER Low Sound Fan on the eco-ATWB-E Closed Circuit Cooler reduces sound levels 9-15 dB(A) and eliminates audible blade passing frequencies indicative of straight bladed axial type fans.

Refer to the Narrow Band Spectrum graph which shows how straight bladed axial fans produce blade passing frequencies – the same phenomena that produce the signature pulsating helicopter noise.

The blade passing frequencies are audible spikes in sound pressure levels, but are not apparent in the octave band sound spectrum.

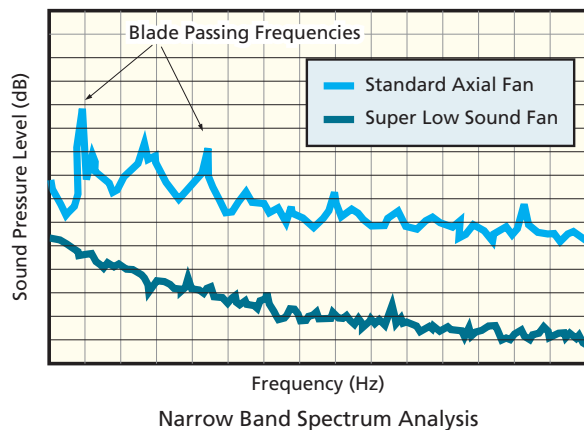

The Super Low Sound Fan on the eco-ATWB-E Closed Circuit Cooler reduces sound levels and betters the sound quality!

NOTE: These low sound options may impact the overall installed dimensions of the eco-ATWB-E Closed Circuit Cooler selected.

SOUND

**ADVANCED TECHNOLOGY
LOW SOUND SOLUTIONS**

eco-ATWB-E

Additional Solutions for Sound Sensitive Applications



Low Sound Fan 4 – 7 dB(A) Reduction!

The Low Sound Fan offered by EVAPCO is a wide chord blade design for sound sensitive applications where low sound levels are desired. The Low Sound Fan shall utilize a unique soft-connect blade-to-hub design that is compatible with Variable Speed Drives.

The Low Sound Fan is capable of reducing the unit sound pressure levels 4 dB(A) to 7 dB(A), depending upon specific unit selection and measurement location. The fans are high efficiency axial propeller type and are available on 2.4 m wide and larger eco-ATWB-E Closed Circuit Coolers.



Water Silencer

Reduces Water Noise in the Cold Water Basin up to 7 dB(A)!

The water silencer option is available for all induced draft models and is located in the falling water area of the cold water basin. The water silencer will reduce the high frequency noise associated with the falling water and is capable of reducing overall sound levels **4 dB(A) to 7 dB(A)** measured at 1.5 m from the side or end of the unit. The water silencers reduce overall sound levels **9 dB(A) to 12 dB(A)** (depending on water loading and louver height) measured 1.5 m from the side or end of the unit when water is circulated with fans off.

The water silencers are constructed of lightweight PVC sections and can be easily removed for access to the basin area. *The water silencer will have no impact on unit thermal performance.*

The Water Silencer is available on ALL eco-ATWB-E Closed Circuit Coolers.

Consult **EvapSelect™** software for unit sound levels. If a detailed analysis or full octave band data sheet is required for your application, please consult your EVAPCO Sales Representative.

SOUND

eco-ATWB-E

SOUND BASIC

Background in Sound Basics

Sound


Sound is the alteration in pressure, stress, particle displacement and particle velocity, which is propagated in an elastic material. Audible sound is the sensation produced at the ear by very small pressure fluctuations in the air.

Sound Pressure

Sound pressure is the *intensity* of sound. Sound pressure, L_p in decibels is the ratio of measured pressure, P in the air to a reference sound pressure, $P_0 = 2 \times 10^{-5}$ Pascal following the following formula:

$$L_p \text{ (dB)} = 10 \log_{10} (\Delta P^2 / \Delta P_0^2)$$

The most important point to understand about sound pressure level is that **sound pressure level is what is actually being measured when sound data is recorded.** Microphones that measure sound are pressure sensitive devices that are calibrated to convert the sound pressure waves into decibels.

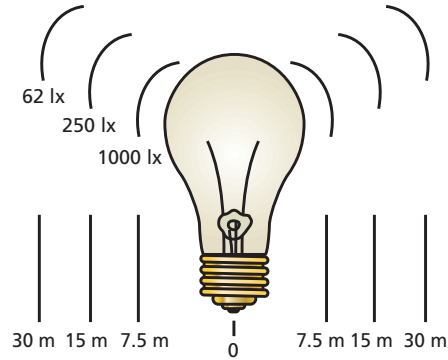

"SOUND PRESSURE"


Similar to the intensity coming from a light bulb which gets dimmer as one gets further and further away, sound pressure decreases in decibels as your ear gets further from the sound source.

Sound Power

Sound Power is the *energy* of sound. Sound power, L_w in decibels is the ratio of the calculated sound power, W to a reference power, $W_0 = 1$ picowatt, according to the following formula:

$$L_w \text{ (dB)} = 10 \log_{10} (W/W_0)$$

The most important point to remember about **sound power level is that sound power level is not a measured value, but is calculated based on the measured sound pressure.**




"SOUND POWER"

Similar to the wattage of a light bulb that does not change the farther one is away from the light bulb, sound power does not vary with distance.

Adding Multiple Sound Sources

Since the decibel is a logarithmic function, the numbers are not added linearly. Therefore, two 73 dB sound sources added together do not equal 146 dB. The resultant sound would actually be 76 dB. The following table shows how to add decibels from two sound sources.

| Difference in dB Level | Add to the higher dB Level |
|------------------------|----------------------------|
| 0 to 1 | 3 |
| 2 to 3 | 2 |
| 4 to 8 | 1 |
| 9 or greater | 0 |

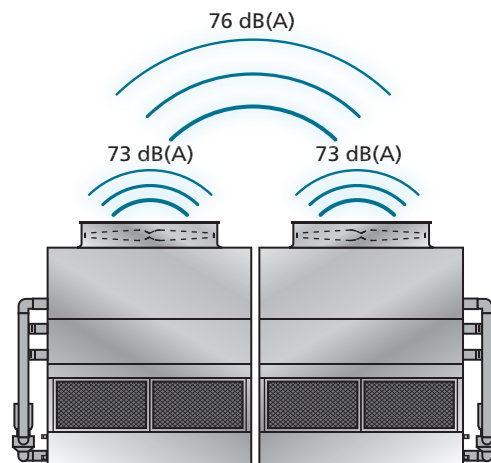


SOUND BASIC

ECO-ATWB-E

Sound Science and Closed Circuit Coolers

Sound Frequency

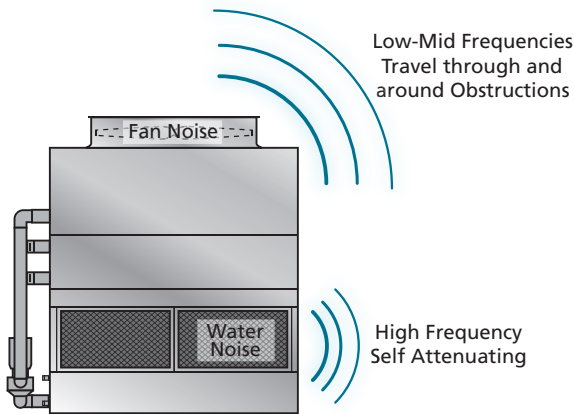

Fan Noise

- Low / Mid frequencies that travel long distances, through walls, and around obstructions.
- Very difficult to attenuate. Reduce fan noise by using Low Sound Fans.
- Dominates what is measured and heard at the Closed Circuit Cooler and at the sound sensitive location.

Water Noise

- High frequencies that attenuate naturally with distance. Attenuated easily by walls, trees or other obstructions.
- Totally masked and drowned out by fan noise at a short distance away from the Closed Circuit Cooler.

Sound Pressure – The A-Weighted Scale

The A-weighted scale, dB(A) is a means to translate what a sound meter microphone measures to how the human ear perceives the sound.

dB(A) Formula and Conversions:

$$dB(A) = 10 \log_{10} \sum_{f=63}^{f=8000} 10^{((dB+C_f)/10)}$$

where: C_f = correction factor per band
 dB = measured sound pressure
 let: $Z_f = (dB + C_f)/10$

| Band | Center Freq. (Hz) | Frequency Range (Hz) | Sample Data (dB) | C _f (dB) | Z _f |
|------|-------------------|----------------------|------------------|---------------------|----------------|
| 1 | 63 | 44-88 | 68 | -26.2 | 4.18 |
| 2 | 125 | 89-175 | 76 | -16.1 | 5.99 |
| 3 | 250 | 176-350 | 77 | -8.6 | 6.84 |
| 4 | 500 | 351-700 | 73 | -3.2 | 6.98 |
| 5 | 1000 | 701-1400 | 70 | 0 | 7.00 |
| 6 | 2000 | 1401-2800 | 68 | +1.2 | 6.92 |
| 7 | 4000 | 2801-5600 | 71 | +1.0 | 7.20 |
| 8 | 8000 | 5601-11200 | 73 | -1.1 | 7.19 |

Typical Sound Pressure Levels of Well Known Noises:

| | |
|--------------------------------|-----------|
| Jet Airplane, 45 meters away | 140 dB(A) |
| Painful | 130 dB(A) |
| Very Uncomfortable | 120 dB(A) |
| Circular Saw | 110 dB(A) |
| Nightclub | 100 dB(A) |
| Semi Truck | 90 dB(A) |
| Sidewalk of a Busy Road | 80 dB(A) |
| Household Vacuum, 1 meter away | 70 dB(A) |
| Normal Conversation | 60 dB(A) |
| Inside Average Home | 50 dB(A) |
| Quiet Library | 40 dB(A) |
| Bedroom at Night | 30 dB(A) |

Notable Facts about Sound:

- +/- 1 dB(A) is inaudible to the human ear
- Decreasing a noise source by 10 dB(A) sounds half as loud to the human ear

Example calculation of the dB(A) formula using the Sample Data above.

$$dB(A) = 10 \log_{10} \sum 10^{Z_1} + 10^{Z_2} + 10^{Z_3} + 10^{Z_4} + 10^{Z_5} + 10^{Z_6} + 10^{Z_7} + 10^{Z_8}$$

$$= 10 \log_{10} (67114245.2) = 78.3 \text{ dB(A)}$$

SOUND

eco-ATWB-E

SPECIFYING SOUND

Sound Verifications

Specify sound pressure in dB(A) measured 1,5 m above the fan discharge during full speed operation.


- All manufacturers can meet a performance specification with Low Sound Options
- Fan noise is what matters. 1,5 m above the fan is where it matters.

Measurement Location

Per Cooling Technology Institute Standard ATC-128


Sound Microphone location 1,5 m above the closed circuit cooler fan cowl edge at a 45° angle.

This position assures accurate sound measurements by eliminating a source of uncertainty by taking the microphone out of the high velocity fan discharge air.

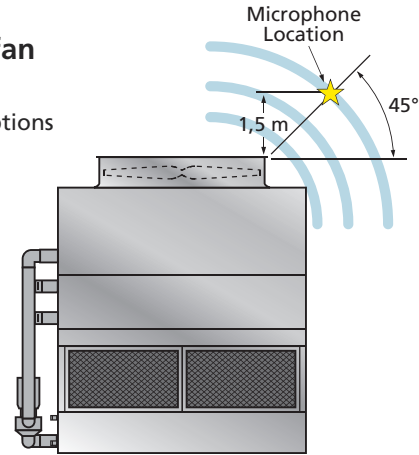

Easy Verification

At 1,5 m from the Closed Circuit Cooler, a sound meter records only closed circuit cooler noise. Interested parties can easily verify the actual noise coming from the closed circuit cooler against the specified sound data with good certainty.

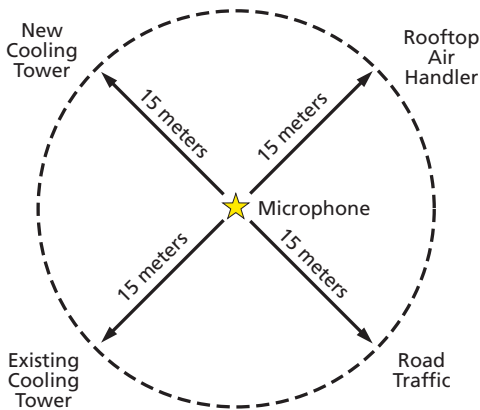

If sound were specified at 15 meters or some greater distance from the sound sensitive location, there is increased uncertainty in the measured data due to other possible sound sources within the 15 meters radius of the sound microphone.

Sound Quality

Sound coming from the top of the closed circuit cooler is comprised of low- and mid-frequency fan noise. Low- and mid-frequency fan "rumble" is very difficult to attenuate. Fan rumble travels through everything and around everything and what is audible at any sound sensitive location.


Sound coming from the sides of the Closed Circuit Cooler is comprised of high frequency water noise, is much less objectionable than fan noise and attenuates naturally with distance.

Acoustical Shadow*

"Subjective reactions to the overall noise generated by Closed Circuit Coolers indicate that as one walks away from a tower intake, a point is reached where the water noise is masked by the fan noise. The point coincides with the point at which one emerges from the acoustical shadow of the Closed Circuit Cooler structure, which shields intake water noise from discharge fan noise."

*Seelbach & Oran, "What To Do About Cooling Tower Noise", Industrial Acoustics Company.

Sound measured at the side of a Closed Circuit Cooler is inside the acoustical shadow of the noise emitted from the top. Outside the acoustical shadow, the low- and mid-frequency fan noise completely masks the high frequency water noise.

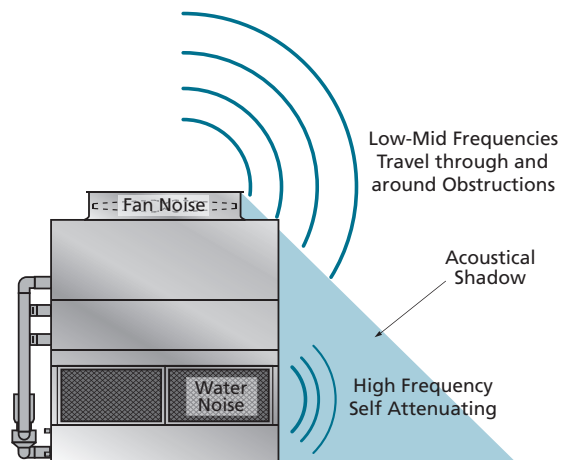

Specify fan noise because it matters! Specify fan noise where it matters!

eco-ATWB-E



We Stand Tall Through it All!

Wind, Rain, Earthquake and Hurricane

The International Building Code (IBC) is a comprehensive set of regulations addressing the structural design and installation requirements for building systems – including HVAC and industrial refrigeration equipment.

With the advent of the IBC, EVAPCO is proud to introduce the new and improved line of eco-ATWB-E Closed Circuit Coolers with IBC 2012 compliance standard.

***EVAPCO Closed Circuit Coolers...
designed to withstand seismic
or wind load forces.***

eco-ATWB-E

IBC COMPLIANCE

In its continuing commitment to be the leaders in evaporative cooling equipment design and services, EVAPCO eco-ATWB-E Closed Circuit Coolers are now **Independently Certified** to withstand Seismic and Wind Loads in accordance with IBC 2012.

What is IBC?

International Building Code

The International Building Code (IBC) is a comprehensive set of regulations addressing both the structural design and the installation requirements for building systems – including HVAC and industrial refrigeration equipment. Compared to previous building codes that considered only the building structure and component anchorage, the requirements contained within the IBC address anchorage, structural integrity, and the operational capability of a component following either a seismic or wind load event. **Simply stated, the IBC code provisions require that evaporative cooling equipment, and all other components permanently installed on a structure, must be designed to meet the same seismic or wind load forces as the building to which they are attached.**

How Does IBC 2012 Apply to Closed Circuit Coolers?

Based on site design factors, calculations are made to determine the equivalent seismic “g force” and wind load (kilo-Newton per square meter, kN/m²) on the unit. The closed circuit cooler must be designed to withstand the greater of either the seismic or wind load.

The New eco-ATW is offered with a choice of TWO structural design packages:

- **Standard Structural Design** – For projects with ≤1.0g seismic or 6,94 kN/m² wind loads
- **Upgraded Structural Design** – Required for projects with >1.0 g seismic or 6,94 kN/m² wind loads

All locations with design criteria resulting in a seismic design force of up to 1.0g or a wind load of 6,94 kN/m² or below will be provided with the standard eco-ATW structural design. An upgraded structural design is available for installations with design criteria resulting in “g forces” greater than 1.0g. The highest “g force” location in North America is 5.12g. The highest wind load shown on the maps is 273 km/h, which is approximately equal to 6,94 kN/m² velocity pressure. **Therefore, the upgraded structural design package option for the New eco-ATWB-E is designed for 5.12 g and 6,94 kN/m² making it applicable to most building locations worldwide.**

Design Implementation

EVAPCO applies the seismic design and wind load information provided for the project to determine the equipment design necessary to meet IBC requirements. This process ensures that the mechanical equipment and its components are compliant per the provisions of the IBC as given in the plans and specifications for the project.

Independent Certification

Although the IBC references and is based on the structural building code ASCE 7, many chapters and paragraphs of ASCE 7 are superceded by the IBC, independent certification and methods of analysis are such paragraphs. Per the most recent edition of the code, the EVAPCO compliance process included an exhaustive analysis by an independent approval agency. As required by the International Building Code, EVAPCO supplies a certificate of compliance as part of its submittal documents. The certificate of compliance demonstrates that the equipment has been independently tested and analyzed in accordance with the IBC seismic and wind load requirements. Evapco has worked closely with the independent approval agency, The VMC Group, to complete the independent equipment testing and analysis.

If the seismic “g force” or wind load psf requirements for the project site are known, EVAPCO’s online equipment selection software, **EvapSelect™**, will allow you to choose the required structural design package – either standard construction or upgraded construction.

For further questions regarding IBC compliance, please contact your local EVAPCO Representative.



IBC

eco-ATWB-E



eco-ATWB-E Closed Circuit Coolers

Eurovent-CTI Certification Purpose

This standard sets forth a program whereby the Cooling Technology Institute will certify that all models of a line of evaporative heat rejection equipment offered for sale by a specific manufacturer will perform thermally in accordance with the manufacturer's published ratings...



***Technology for
the Future,
Available Today!***

ECC-CTI

eco-ATWB-E

CTI CERTIFICATION

In its continuing commitment to be the leaders in evaporative cooling equipment design and services, EVAPCO eco-ATWB-E Closed Circuit Coolers are now **Independently Certified** by **CTI**, to perform thermally in accordance with the published data.

What is CTI?

Cooling Technology Institute

The Cooling Technology Institute is an organization headquartered in the United States with over 400 member companies from around the globe. CTI membership is composed of manufacturers, suppliers, owner operators, and test agencies from over 40 countries. In 2008 CTI certified more than 5000 Evaporative Heat Transfer Systems (EHTS) from 49 product line of 24 participants.

CTI's Mission and Objectives

This can be best explained by the CTI's published Mission statement and Objectives revised in December 2003 and published on their website www.cti.org.


CTI Mission Statement

To advocate and promote the use of environmentally responsible Evaporative Heat Transfer Systems (EHTS) for the benefit of the public by encouraging:

- Education
- Research
- Standards Development and Verification
- Government Relations
- Technical Information Exchange

CTI Objectives

- Maintain and expand a broad base membership of individuals and organizations interested in Evaporative Heat Transfer Systems (EHTS).
- Identify and address emerging and evolving issues concerning EHTS.
- Encourage and support educational programs in various formats to enhance the capabilities and competence of the industry to realize the maximum benefit of EHTS.
- Encourage and support cooperative research to improve EHTS technology and efficiency for the long-term benefit of the environment.
- Assure acceptable minimum quality levels and performance of EHTS and their components by establishing standard specifications, guidelines, and certification programs.
- Establish standard testing and performance analysis systems and procedures for EHTS.
- Communicate with and influence governmental entities regarding the environmentally responsible technologies, benefits, and issues associated with EHTS.
- Encourage and support forums and methods for exchanging technical information on EHTS.

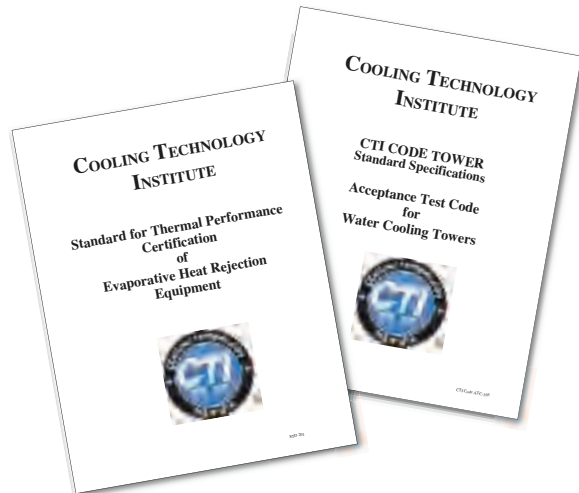

Benefits to the End User

CTI defines an independent testing certification program that is specifiable, enforceable and available to all equipment manufacturer's. End users that purchase CTI certified products are assured that those products will perform thermally as specified.

Additionally CTI certification is the first step for the Green Building Concept in Europe:

- LEED - Leadership in Energy and Environmental Design
- Best Available Practice
- Green Building Rating System

Thermal Performance Guarantee

In addition to the CTI Certification, Evapco unequivocally guarantees the Thermal Performance of ALL Evapco Equipment. Every unit order is confirmed with a submittal package that includes an Evapco Thermal Performance Guarantee Certificate.



CTI CERTIFICATION

eco-ATWB-E

CTI Certification Program

CTI Certification Process

- Submit Application for Certification
- CTI completes a technical review of the product line submitted
- CTI performs an initial qualification test in a laboratory on a specified model number
- CTI issues an Approval Letter with Validation Number if test is passed. Letter is also distributed to all members of CTI to inform everyone that a successful certification has been completed. The Certification Validation Number assigned should be fixed to each tower sold and displayed in all catalogs and other literature
- Product Line must undergo an Annual Reverification Test - Different model number is selected every year
- More details can be found on the CTI website www.cti.org

CTI Certification Test Parameters

- Entering Wet Bulb temperature - 12.8°C to 32.2°C
- Cooling Range - Minimum of 2.2°C
- Cooling Approach - Minimum of 2.8°C
- Process Fluid Temperature - Maximum of 51.7°C
- Barometric Pressure - 91.4 to 105 kPa
- More details can be found on the CTI website www.cti.org

CTI Certification Limitations

- Specific manufacturer's product line name and model numbers
- Applicable only to product lines and model numbers submitted
- Multiple cell model numbers are allowed if the airflow is not affected or the configuration impact is included in the unit rating
- Optional accessories are allowed if the airflow is not affected or the accessory impact is accounted for in the rating
- More details can be found on the CTI website www.cti.org

Evapco Europe CTI Certified eco-ATWB-E Product Line

eco-ATWB-E lines of CTI Certified Closed Circuit Coolers

- Includes the use of side, end or bottom water inlet configuration
- Includes optional Super Low Sound Fan (SLSF)
- Includes optional pan Water Silencers (WS)
- Includes optional external service platform and ladders for access
- **EvapSelect™** Technical data sheet will state "CTI Certified Selection" if the selection falls within the CTI Certification Test Parameters
- Unit will receive a CTI Certified Shield located near the nameplate

Note

All CTI Certified Product Lines of all manufacturers with CTI certified products can be found on the website: <http://www.cti.org/certification.shtml>



Mark owned by the Cooling Technology Institute

eco-ATWB-E

EUROVENT-CTI CERTIFICATION

In 2007 Evapco launched the initiative to create the "European Chapter" of CTI. At the start of this initiative, Eurovent and CTI established a "Memorandum of Understanding". Since then the "Operational Manual for Certification of Cooling Towers" and the "Eurovent Rating Standard for Cooling Towers" were written. Both documents are strongly tied to the CTI documents STD 201 and ATC 105. A common "Eurovent-CTI" Certification program has become the European Standard for independent thermal performance rating of cooling towers.

EUROVENT – CTI cooperation

EUROVENT Association

Initially founded in 1958 EUROVENT Association represents the European refrigeration, air conditioning, air handling, heating and ventilation industry and trade associations from European and non-European countries. Over 1000 companies in 13 European countries, employing 150000 employees who jointly generate more than € 25 to 30 billion of annual output are member of this organization.



EUROVENT mission

EUROVENT represents, promotes and defends the industry to relevant national and international bodies and cooperates with other European umbrella associations. Over the years EUROVENT has become a well-known and respected stakeholder in all industry related matters and, in particular, in climate change and energy efficiency. EUROVENT develops product certification programs for the entire industry through the EUROVENT Certification Company.

EUROVENT Certification




The main objective of the EUROVENT Certification Company (ECC) is to certify cooling equipment (and/or components) independently from EUROVENT Association. With a common set of well-defined procedures and criteria for the rating of products, comparison of product performance ensures a healthy and solid competition on a market open to all manufacturers. When a manufacturer participates in a certification program, he has to present its list of models or model ranges together with their performance data. The files are evaluated by the ECC Certification and a predefined number of units are selected for testing by **independent laboratories**. If the results comply with the relevant standards, the submitted models or ranges will be listed in the **EUROVENT Certification Online Directory**. Models are subject to regular random testing to verify compliance with catalogue data.

Benefits

The Certification Mark guarantees specifying engineers, installers and end users that the products marketed by a participant have been submitted to independent testing and that they have been accurately rated. Through specification of **certified products**, the engineer's tasks become easier, since there is no need to carry out detailed comparison and performance testing.



eco-ATWB-E

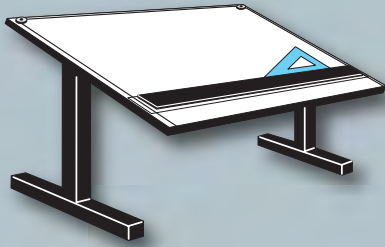


Engineering Data & Dimensions

eco-ATWB-E

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E Models 9-3G8 to 9-6J8

ENGINEERING

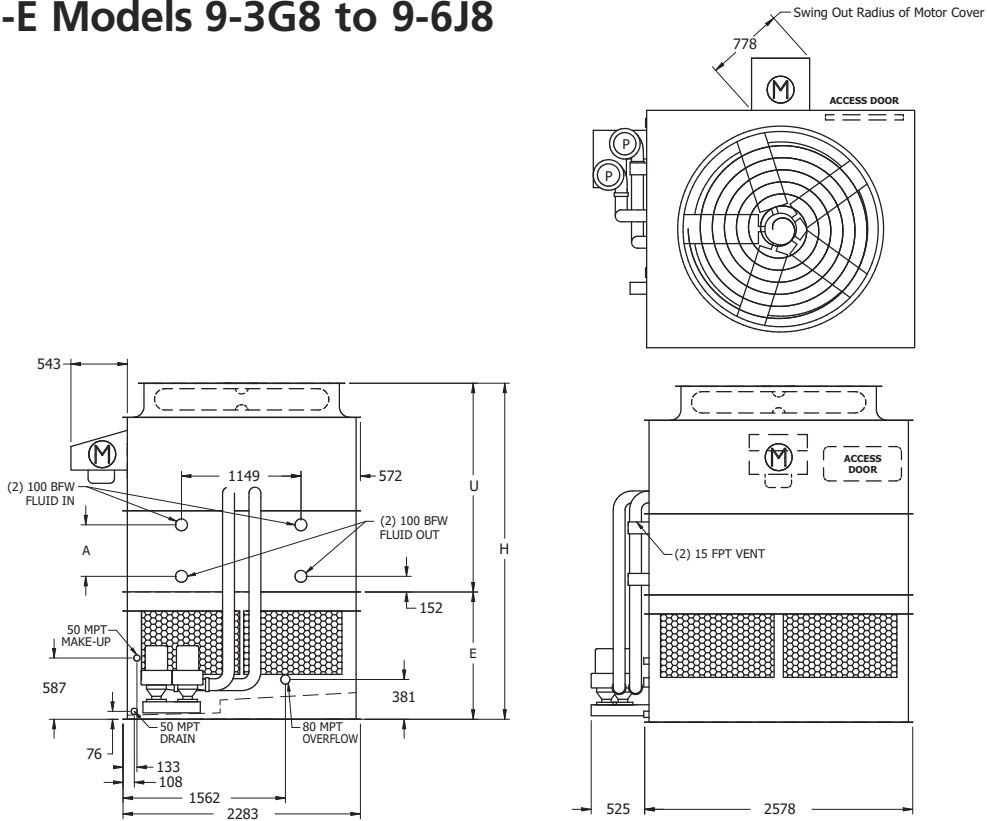

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional **Low & Super Low Sound Fan** execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 9-3G8 | 3760 | 3100 | 5310 | 4 | 13,7 | (2) 0.55 | 542 | 835 | 200 | 4780 | 3233 | 1226 | 2007 | 495 |
| eco-ATWB-E 9-3H8 | 3780 | 3120 | 5330 | 5,5 | 15,7 | (2) 0.55 | 542 | 835 | 200 | 4800 | 3233 | 1226 | 2007 | 495 |
| eco-ATWB-E 9-3I8 | 3780 | 3120 | 5330 | 7,5 | 17,2 | (2) 0.55 | 542 | 835 | 200 | 4800 | 3233 | 1226 | 2007 | 495 |
| eco-ATWB-E 9-3J8 | 3840 | 3180 | 5390 | 11 | 19,3 | (2) 0.55 | 542 | 835 | 200 | 4860 | 3233 | 1226 | 2007 | 495 |
| eco-ATWB-E 9-4G8 | 4380 | 3720 | 6090 | 4 | 13,3 | (2) 0.55 | 707 | 835 | 200 | 5560 | 3423 | 1226 | 2197 | 686 |
| eco-ATWB-E 9-4H8 | 4400 | 3740 | 6110 | 5,5 | 15,2 | (2) 0.55 | 707 | 835 | 200 | 5580 | 3423 | 1226 | 2197 | 686 |
| eco-ATWB-E 9-4I8 | 4400 | 3740 | 6120 | 7,5 | 16,7 | (2) 0.55 | 707 | 835 | 200 | 5590 | 3423 | 1226 | 2197 | 686 |
| eco-ATWB-E 9-4J8 | 4460 | 3800 | 6180 | 11 | 18,7 | (2) 0.55 | 707 | 835 | 200 | 5650 | 3423 | 1226 | 2197 | 686 |
| eco-ATWB-E 9-5H8 | 5060 | 4400 | 6940 | 5,5 | 14,8 | (2) 0.55 | 872 | 835 | 200 | 6410 | 3614 | 1226 | 2388 | 876 |
| eco-ATWB-E 9-5I8 | 5060 | 4410 | 6950 | 7,5 | 16,2 | (2) 0.55 | 872 | 835 | 200 | 6420 | 3614 | 1226 | 2388 | 876 |
| eco-ATWB-E 9-5J8 | 5120 | 4460 | 7010 | 11 | 18,1 | (2) 0.55 | 872 | 835 | 200 | 6480 | 3614 | 1226 | 2388 | 876 |
| eco-ATWB-E 9-6H8 | 5710 | 5050 | 7760 | 5,5 | 14,3 | (2) 0.55 | 1038 | 835 | 200 | 7230 | 3804 | 1226 | 2578 | 1067 |
| eco-ATWB-E 9-6I8 | 5720 | 5060 | 7760 | 7,5 | 15,7 | (2) 0.55 | 1038 | 835 | 200 | 7230 | 3804 | 1226 | 2578 | 1067 |
| eco-ATWB-E 9-6J8 | 5780 | 5120 | 7820 | 11 | 17,6 | (2) 0.55 | 1038 | 835 | 200 | 7290 | 3804 | 1226 | 2578 | 1067 |

The motors are shipped loose for field mounting

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.


[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.

Coil connections are 4" bevel for welding (BFW)

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E

eco-ATWB-E Models 8-3G9 to 8-6K9

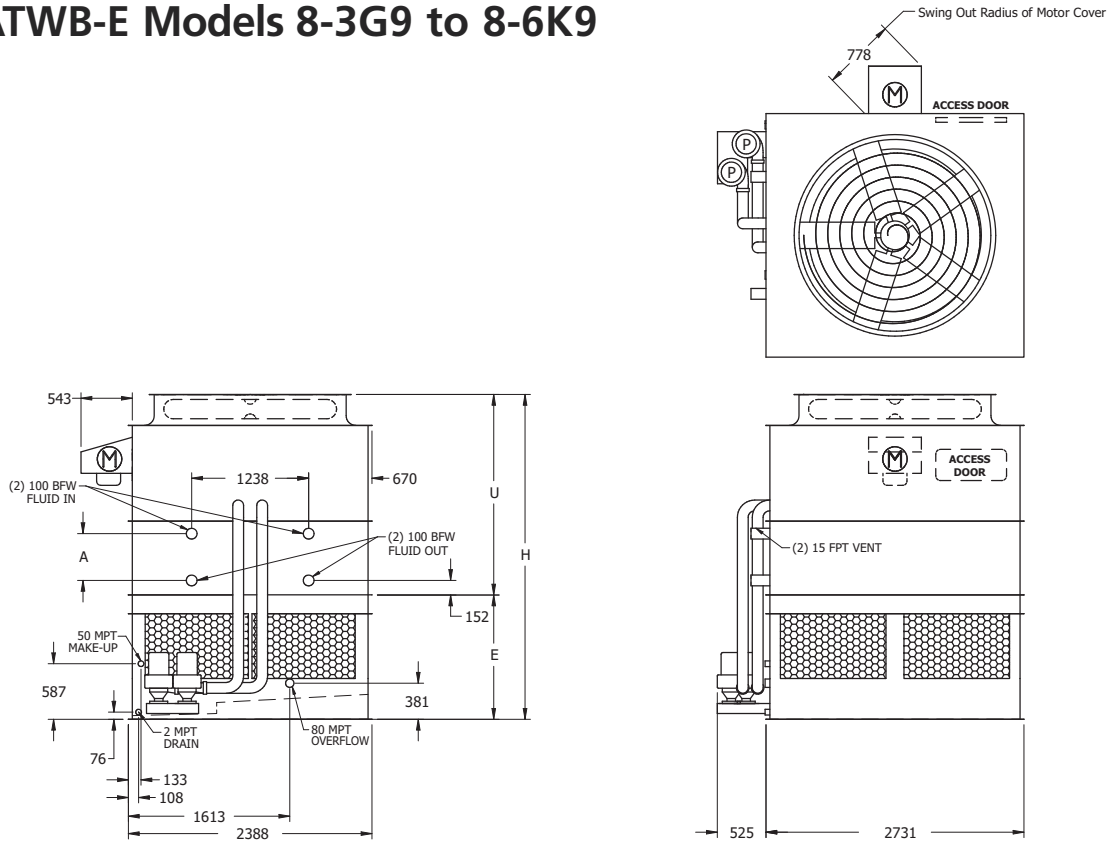

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional **Low & Super Low Sound Fan** execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 8-3G9 | 4210 | 3500 | 5890 | 4 | 14,7 | (2) 0.75 | 576 | 910 | 200 | 5300 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-3H9 | 4230 | 3530 | 5920 | 5,5 | 16,8 | (2) 0.75 | 576 | 910 | 200 | 5330 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-3I9 | 4240 | 3530 | 5920 | 7,5 | 18,5 | (2) 0.75 | 576 | 910 | 200 | 5330 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-3J9 | 4300 | 3590 | 5980 | 11 | 20,7 | (2) 0.75 | 576 | 910 | 200 | 5390 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-4G9 | 4900 | 4190 | 6760 | 4 | 14,2 | (2) 0.75 | 751 | 910 | 200 | 6170 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-4H9 | 4920 | 4210 | 6780 | 5,5 | 16,3 | (2) 0.75 | 751 | 910 | 200 | 6190 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-4I9 | 4920 | 4220 | 6780 | 7,5 | 17,9 | (2) 0.75 | 751 | 910 | 200 | 6190 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-4J9 | 4980 | 4280 | 6840 | 11 | 20,1 | (2) 0.75 | 751 | 910 | 200 | 6250 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-4K9 | 5010 | 4300 | 6870 | 15 | 21,8 | (2) 0.75 | 751 | 910 | 200 | 6280 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-5G9 | 5630 | 4920 | 7670 | 4 | 13,8 | (2) 0.75 | 926 | 910 | 200 | 7080 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-5H9 | 5650 | 4950 | 7690 | 5,5 | 15,8 | (2) 0.75 | 926 | 910 | 200 | 7100 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-5I9 | 5660 | 4950 | 7690 | 7,5 | 17,4 | (2) 0.75 | 926 | 910 | 200 | 7100 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-5J9 | 5720 | 5010 | 7750 | 11 | 19,5 | (2) 0.75 | 926 | 910 | 200 | 7160 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-5K9 | 5740 | 5040 | 7780 | 15 | 21,1 | (2) 0.75 | 926 | 910 | 200 | 7190 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-6G9 | 6350 | 5650 | 8560 | 4 | 13,4 | (2) 0.75 | 1102 | 910 | 200 | 7970 | 4010 | 1318 | 2692 | 1067 |
| eco-ATWB-E 8-6H9 | 6380 | 5670 | 8590 | 5,5 | 15,3 | (2) 0.75 | 1102 | 910 | 200 | 8000 | 4010 | 1318 | 2692 | 1067 |
| eco-ATWB-E 8-6I9 | 6380 | 5670 | 8590 | 7,5 | 16,9 | (2) 0.75 | 1102 | 910 | 200 | 8000 | 4010 | 1318 | 2692 | 1067 |
| eco-ATWB-E 8-6J9 | 6440 | 5730 | 8650 | 11 | 18,9 | (2) 0.75 | 1102 | 910 | 200 | 8060 | 4010 | 1318 | 2692 | 1067 |
| eco-ATWB-E 8-6K9 | 6470 | 5760 | 8680 | 15 | 20,5 | (2) 0.75 | 1102 | 910 | 200 | 8090 | 4010 | 1318 | 2692 | 1067 |

The motors are shipped loose for field mounting

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.

[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.




Coil connections are 4" bevel for welding (BFW)

ENGINEERING

eco-ATWB-E

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E Models 8-3H11 to 8-6K11

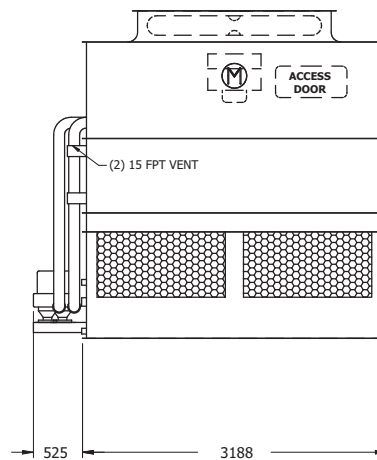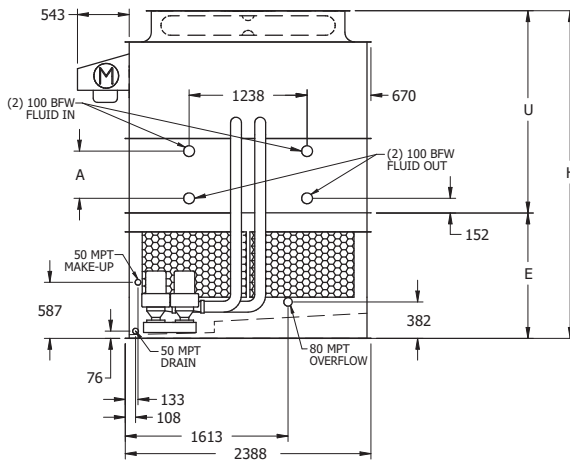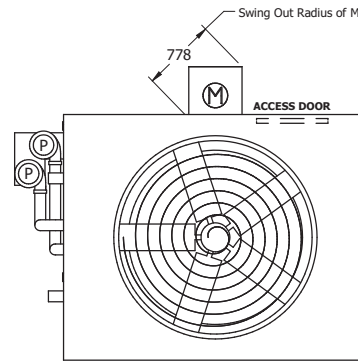

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional **Low & Super Low Sound Fan** execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 8-3H11 | 4870 | 4070 | 6850 | 5,5 | 18,6 | (2) 1.1 | 666 | 1060 | 250 | 6170 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-3I11 | 4880 | 4080 | 6860 | 7,5 | 20,5 | (2) 1.1 | 666 | 1060 | 250 | 6180 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-3J11 | 4930 | 4140 | 6910 | 11 | 23,1 | (2) 1.1 | 666 | 1060 | 250 | 6230 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-3K11 | 4960 | 4170 | 6940 | 15 | 25,1 | (2) 1.1 | 666 | 1060 | 250 | 6260 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-4H11 | 5670 | 4870 | 7850 | 5,5 | 18,1 | (2) 1.1 | 871 | 1060 | 250 | 7170 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-4I11 | 5680 | 4880 | 7860 | 7,5 | 19,9 | (2) 1.1 | 871 | 1060 | 250 | 7180 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-4J11 | 5730 | 4940 | 7920 | 11 | 22,5 | (2) 1.1 | 871 | 1060 | 250 | 7240 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-4K11 | 5760 | 4960 | 7940 | 15 | 24,3 | (2) 1.1 | 871 | 1060 | 250 | 7260 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-5H11 | 6530 | 5730 | 8920 | 5,5 | 17,5 | (2) 1.1 | 1077 | 1060 | 250 | 8240 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-5I11 | 6540 | 5740 | 8930 | 7,5 | 19,3 | (2) 1.1 | 1077 | 1060 | 250 | 8250 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-5J11 | 6590 | 5800 | 8980 | 11 | 21,8 | (2) 1.1 | 1077 | 1060 | 250 | 8300 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-5K11 | 6620 | 5830 | 9010 | 15 | 23,6 | (2) 1.1 | 1077 | 1060 | 250 | 8330 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-6H11 | 7370 | 6570 | 9960 | 5,5 | 17,0 | (2) 1.1 | 1282 | 1060 | 250 | 9280 | 4010 | 1318 | 2692 | 1067 |
| eco-ATWB-E 8-6I11 | 7380 | 6580 | 9970 | 7,5 | 18,7 | (2) 1.1 | 1282 | 1060 | 250 | 9290 | 4010 | 1318 | 2692 | 1067 |
| eco-ATWB-E 8-6J11 | 7430 | 6640 | 10030 | 11 | 21,1 | (2) 1.1 | 1282 | 1060 | 250 | 9350 | 4010 | 1318 | 2692 | 1067 |
| eco-ATWB-E 8-6K11 | 7460 | 6660 | 10050 | 15 | 22,9 | (2) 1.1 | 1282 | 1060 | 250 | 9370 | 4010 | 1318 | 2692 | 1067 |

The motors are shipped loose for field mounting

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.



[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.

Coil connections are 4" bevel for welding (BFW)

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E

eco-ATWB-E Models 8-3H12 to 8-6L12

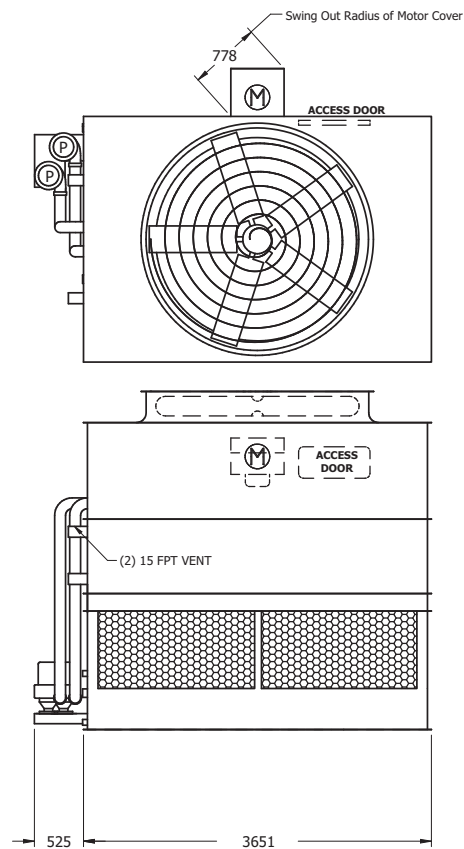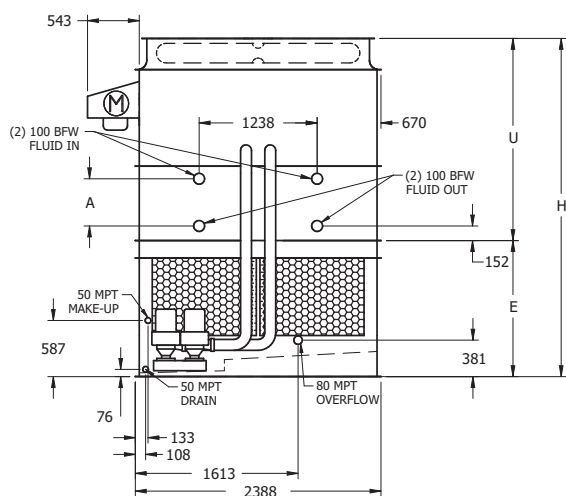

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional **Low & Super Low Sound Fan** execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 8-3H12 | 5300 | 4420 | 7590 | 5,5 | 20,4 | (2) 1.1 | 756 | 1210 | 250 | 6830 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-3I12 | 5310 | 4430 | 7600 | 7,5 | 22,4 | (2) 1.1 | 756 | 1210 | 250 | 6840 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-3J12 | 5360 | 4480 | 7660 | 11 | 25,5 | (2) 1.1 | 756 | 1210 | 250 | 6890 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-3K12 | 5390 | 4510 | 7680 | 15 | 27,7 | (2) 1.1 | 756 | 1210 | 250 | 6920 | 3439 | 1318 | 2121 | 495 |
| eco-ATWB-E 8-4H12 | 6230 | 5360 | 8760 | 5,5 | 19,8 | (2) 1.1 | 991 | 1210 | 250 | 8000 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-4I12 | 6240 | 5360 | 8770 | 7,5 | 21,8 | (2) 1.1 | 991 | 1210 | 250 | 8010 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-4J12 | 6300 | 5420 | 8830 | 11 | 24,8 | (2) 1.1 | 991 | 1210 | 250 | 8070 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-4K12 | 6320 | 5450 | 8860 | 15 | 26,9 | (2) 1.1 | 991 | 1210 | 250 | 8090 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-4L12 | 6340 | 5460 | 8870 | 18,5 | 28,6 | (2) 1.1 | 991 | 1210 | 250 | 8110 | 3629 | 1318 | 2311 | 686 |
| eco-ATWB-E 8-5H12 | 7170 | 6290 | 9930 | 5,5 | 19,2 | (2) 1.1 | 1227 | 1210 | 250 | 9170 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-5I12 | 7170 | 6300 | 9940 | 7,5 | 21,1 | (2) 1.1 | 1227 | 1210 | 250 | 9180 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-5J12 | 7230 | 6350 | 10000 | 11 | 24,0 | (2) 1.1 | 1227 | 1210 | 250 | 9230 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-5K12 | 7260 | 6380 | 10020 | 15 | 26,0 | (2) 1.1 | 1227 | 1210 | 250 | 9260 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-5L12 | 7270 | 6390 | 10040 | 18,5 | 27,7 | (2) 1.1 | 1227 | 1210 | 250 | 9270 | 3820 | 1318 | 2502 | 876 |
| eco-ATWB-E 8-6H12 | 8130 | 7260 | 11140 | 5,5 | 18,6 | (2) 1.1 | 1462 | 1210 | 250 | 10370 | 4010 | 1318 | 2692 | 1067 |
| eco-ATWB-E 8-6I12 | 8140 | 7260 | 11140 | 7,5 | 20,5 | (2) 1.1 | 1462 | 1210 | 250 | 10380 | 4010 | 1318 | 2692 | 1067 |
| eco-ATWB-E 8-6J12 | 8200 | 7320 | 11200 | 11 | 23,3 | (2) 1.1 | 1462 | 1210 | 250 | 10440 | 4010 | 1318 | 2692 | 1067 |
| eco-ATWB-E 8-6K12 | 8220 | 7350 | 11230 | 15 | 25,2 | (2) 1.1 | 1462 | 1210 | 250 | 10460 | 4010 | 1318 | 2692 | 1067 |
| eco-ATWB-E 8-6L12 | 8240 | 7360 | 11240 | 18,5 | 26,9 | (2) 1.1 | 1462 | 1210 | 250 | 10480 | 4010 | 1318 | 2692 | 1067 |

The motors are shipped loose for field mounting

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.



[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.

Coil connections are 4" bevel for welding (BFW)

eco-ATWB-E

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E Models 8-3I14 to 8-6M14

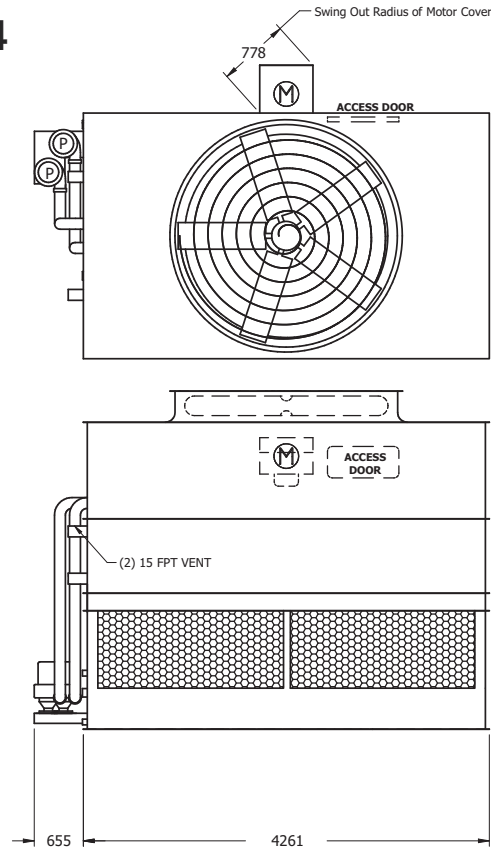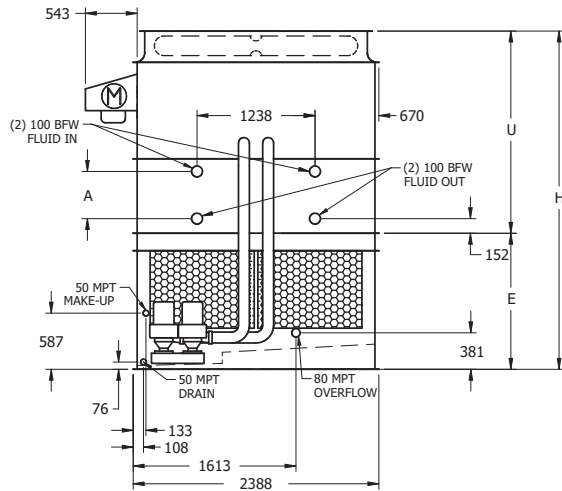

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional **Low & Super Low Sound Fan** execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 8-3I14 | 6040 | 5040 | 8720 | 7,5 | 24,9 | (2) 1.5 | 876 | 1365 | 250 | 7820 | 3550 | 1429 | 2121 | 495 |
| eco-ATWB-E 8-3J14 | 6100 | 5090 | 8770 | 11 | 28,5 | (2) 1.5 | 876 | 1365 | 250 | 7870 | 3550 | 1429 | 2121 | 495 |
| eco-ATWB-E 8-3K14 | 6130 | 5120 | 8800 | 15 | 30,9 | (2) 1.5 | 876 | 1365 | 250 | 7900 | 3550 | 1429 | 2121 | 495 |
| eco-ATWB-E 8-3L14 | 6140 | 5140 | 8810 | 18,5 | 32,9 | (2) 1.5 | 876 | 1365 | 250 | 7910 | 3550 | 1429 | 2121 | 495 |
| eco-ATWB-E 8-4I14 | 7130 | 6120 | 10070 | 7,5 | 24,1 | (2) 1.5 | 1152 | 1365 | 250 | 9170 | 3740 | 1429 | 2311 | 686 |
| eco-ATWB-E 8-4J14 | 7180 | 6180 | 10130 | 11 | 27,6 | (2) 1.5 | 1152 | 1365 | 250 | 9230 | 3740 | 1429 | 2311 | 686 |
| eco-ATWB-E 8-4K14 | 7210 | 6210 | 10150 | 15 | 30,0 | (2) 1.5 | 1152 | 1365 | 250 | 9260 | 3740 | 1429 | 2311 | 686 |
| eco-ATWB-E 8-4L14 | 7220 | 6220 | 10170 | 18,5 | 31,9 | (2) 1.5 | 1152 | 1365 | 250 | 9270 | 3740 | 1429 | 2311 | 686 |
| eco-ATWB-E 8-4M14 | 7250 | 6240 | 10190 | 22 | 33,6 | (2) 1.5 | 1152 | 1365 | 250 | 9290 | 3740 | 1429 | 2311 | 686 |
| eco-ATWB-E 8-5I14 | 8210 | 7200 | 11430 | 7,5 | 23,4 | (2) 1.5 | 1427 | 1365 | 250 | 10530 | 3931 | 1429 | 2502 | 876 |
| eco-ATWB-E 8-5J14 | 8260 | 7260 | 11480 | 11 | 26,8 | (2) 1.5 | 1427 | 1365 | 250 | 10590 | 3931 | 1429 | 2502 | 876 |
| eco-ATWB-E 8-5K14 | 8290 | 7290 | 11510 | 15 | 29,1 | (2) 1.5 | 1427 | 1365 | 250 | 10610 | 3931 | 1429 | 2502 | 876 |
| eco-ATWB-E 8-5L14 | 8300 | 7300 | 11520 | 18,5 | 31,0 | (2) 1.5 | 1427 | 1365 | 250 | 10630 | 3931 | 1429 | 2502 | 876 |
| eco-ATWB-E 8-5M14 | 8330 | 7320 | 11550 | 22 | 32,6 | (2) 1.5 | 1427 | 1365 | 250 | 10650 | 3931 | 1429 | 2502 | 876 |
| eco-ATWB-E 8-6I14 | 9330 | 8330 | 12830 | 7,5 | 22,7 | (2) 1.5 | 1702 | 1365 | 250 | 11930 | 4121 | 1429 | 2692 | 1067 |
| eco-ATWB-E 8-6J14 | 9390 | 8380 | 12880 | 11 | 26,0 | (2) 1.5 | 1702 | 1365 | 250 | 11990 | 4121 | 1429 | 2692 | 1067 |
| eco-ATWB-E 8-6K14 | 9410 | 8410 | 12910 | 15 | 28,2 | (2) 1.5 | 1702 | 1365 | 250 | 12010 | 4121 | 1429 | 2692 | 1067 |
| eco-ATWB-E 8-6L14 | 9430 | 8420 | 12930 | 18,5 | 30,0 | (2) 1.5 | 1702 | 1365 | 250 | 12030 | 4121 | 1429 | 2692 | 1067 |
| eco-ATWB-E 8-6M14 | 9450 | 8450 | 12950 | 22 | 31,6 | (2) 1.5 | 1702 | 1365 | 250 | 12050 | 4121 | 1429 | 2692 | 1067 |

The motors are shipped loose for field mounting

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.



[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.

Coil connections are 4" bevel for welding (BFW)

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E

eco-ATWB-E Models 8-3G18 to 8-6K18

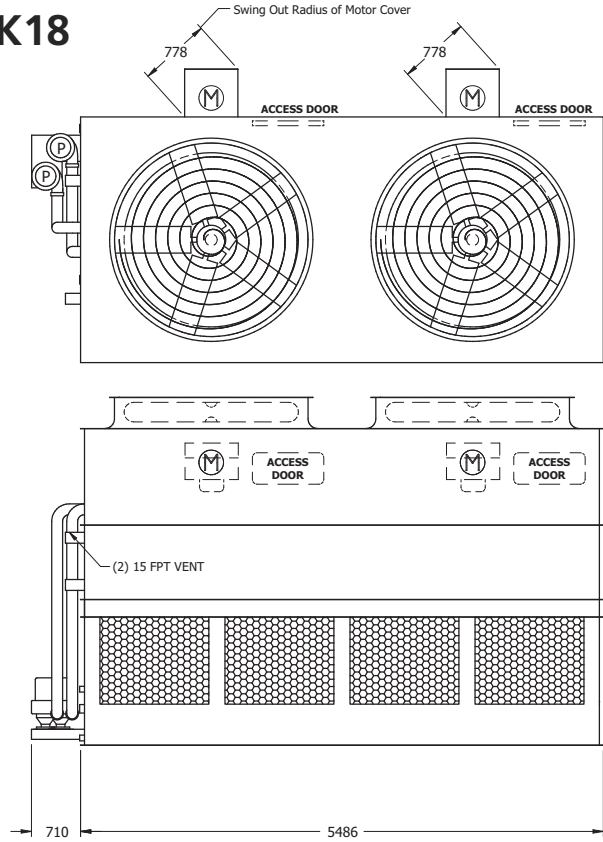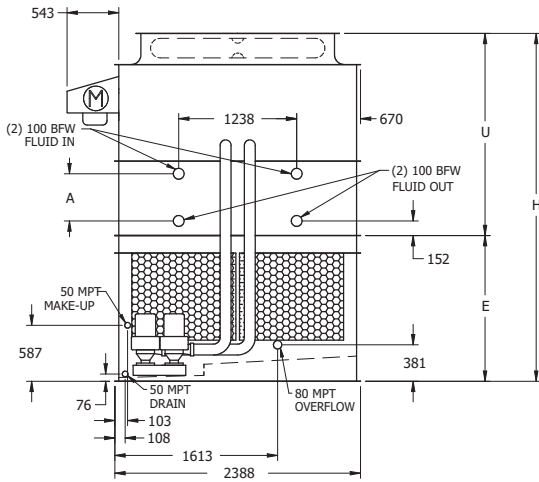

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional Low & Super Low Sound Fan execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|---------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 8-3G18 | 7990 | 6660 | 11450 | (2) 4 | 29,3 | (2) 2.2 | 1117 | 1815 | 300 | 10330 | 3651 | 1530 | 2121 | 495 |
| eco-ATWB-E 8-3H18 | 8040 | 6700 | 11490 | (2) 5.5 | 33,6 | (2) 2.2 | 1117 | 1815 | 300 | 10370 | 3651 | 1530 | 2121 | 495 |
| eco-ATWB-E 8-3I18 | 8050 | 6720 | 11500 | (2) 7.5 | 37,0 | (2) 2.2 | 1117 | 1815 | 300 | 10380 | 3651 | 1530 | 2121 | 495 |
| eco-ATWB-E 8-3J18 | 8170 | 6830 | 11620 | (2) 11 | 41,4 | (2) 2.2 | 1117 | 1815 | 300 | 10500 | 3651 | 1530 | 2121 | 495 |
| eco-ATWB-E 8-4G18 | 9400 | 8070 | 13210 | (2) 4 | 28,5 | (2) 2.2 | 1472 | 1815 | 300 | 12090 | 3842 | 1530 | 2311 | 686 |
| eco-ATWB-E 8-4H18 | 9450 | 8110 | 13260 | (2) 5.5 | 32,6 | (2) 2.2 | 1472 | 1815 | 300 | 12140 | 3842 | 1530 | 2311 | 686 |
| eco-ATWB-E 8-4I18 | 9460 | 8130 | 13270 | (2) 7.5 | 35,9 | (2) 2.2 | 1472 | 1815 | 300 | 12150 | 3842 | 1530 | 2311 | 686 |
| eco-ATWB-E 8-4J18 | 9580 | 8240 | 13380 | (2) 11 | 40,2 | (2) 2.2 | 1472 | 1815 | 300 | 12260 | 3842 | 1530 | 2311 | 686 |
| eco-ATWB-E 8-4K18 | 9630 | 8300 | 13440 | (2) 15 | 43,6 | (2) 2.2 | 1472 | 1815 | 300 | 12320 | 3842 | 1530 | 2311 | 686 |
| eco-ATWB-E 8-5G18 | 10790 | 9450 | 14950 | (2) 4 | 27,6 | (2) 2.2 | 1827 | 1815 | 300 | 13830 | 4032 | 1530 | 2502 | 876 |
| eco-ATWB-E 8-5H18 | 10830 | 9500 | 14990 | (2) 5.5 | 31,6 | (2) 2.2 | 1827 | 1815 | 300 | 13870 | 4032 | 1530 | 2502 | 876 |
| eco-ATWB-E 8-5I18 | 10850 | 9510 | 15010 | (2) 7.5 | 34,8 | (2) 2.2 | 1827 | 1815 | 300 | 13890 | 4032 | 1530 | 2502 | 876 |
| eco-ATWB-E 8-5J18 | 10960 | 9630 | 15120 | (2) 11 | 39,0 | (2) 2.2 | 1827 | 1815 | 300 | 14000 | 4032 | 1530 | 2502 | 876 |
| eco-ATWB-E 8-5K18 | 11020 | 9680 | 15170 | (2) 15 | 42,3 | (2) 2.2 | 1827 | 1815 | 300 | 14050 | 4032 | 1530 | 2502 | 876 |
| eco-ATWB-E 8-6G18 | 12250 | 10910 | 16770 | (2) 4 | 26,8 | (2) 2.2 | 2183 | 1815 | 300 | 15650 | 4222 | 1530 | 2692 | 1067 |
| eco-ATWB-E 8-6H18 | 12290 | 10960 | 16810 | (2) 5.5 | 30,6 | (2) 2.2 | 2183 | 1815 | 300 | 15690 | 4222 | 1530 | 2692 | 1067 |
| eco-ATWB-E 8-6I18 | 12310 | 10970 | 16830 | (2) 7.5 | 33,7 | (2) 2.2 | 2183 | 1815 | 300 | 15710 | 4222 | 1530 | 2692 | 1067 |
| eco-ATWB-E 8-6J18 | 12420 | 11090 | 16940 | (2) 11 | 37,8 | (2) 2.2 | 2183 | 1815 | 300 | 15820 | 4222 | 1530 | 2692 | 1067 |
| eco-ATWB-E 8-6K18 | 12480 | 11140 | 16990 | (2) 15 | 40,9 | (2) 2.2 | 2183 | 1815 | 300 | 15870 | 4222 | 1530 | 2692 | 1067 |

The motors are shipped loose for field mounting

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.

[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.



Coil connections are 4" bevel for welding (BFW)

ENGINEERING

eco-ATWB-E

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E Models 8-3H21 to 8-6K21

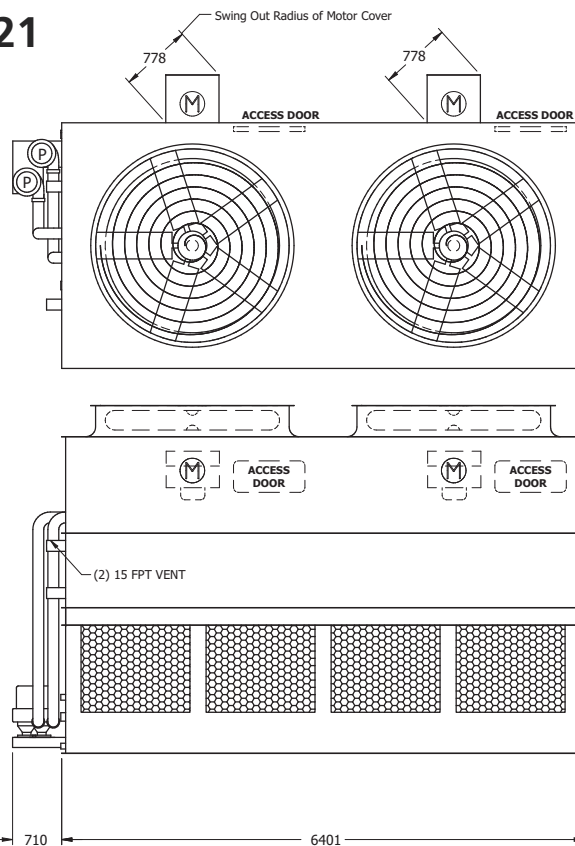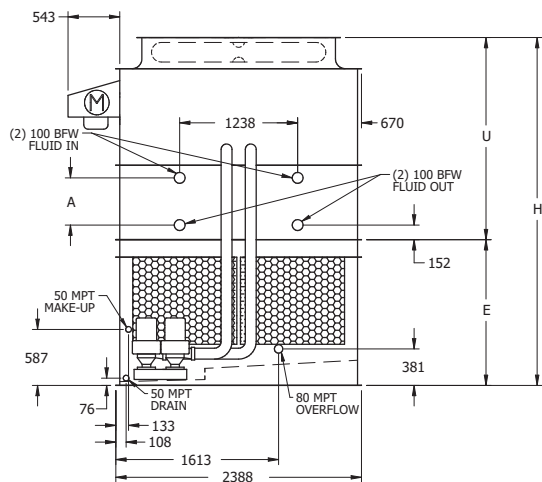

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional Low & Super Low Sound Fan execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|---------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 8-3H21 | 9160 | 7670 | 13230 | (2) 5.5 | 37,3 | (2) 2.2 | 1297 | 2120 | 300 | 11900 | 3651 | 1530 | 2121 | 495 |
| eco-ATWB-E 8-3I21 | 9180 | 7690 | 13240 | (2) 7.5 | 41,1 | (2) 2.2 | 1297 | 2120 | 300 | 11920 | 3651 | 1530 | 2121 | 495 |
| eco-ATWB-E 8-3J21 | 9290 | 7800 | 13350 | (2) 11 | 46,4 | (2) 2.2 | 1297 | 2120 | 300 | 12030 | 3651 | 1530 | 2121 | 495 |
| eco-ATWB-E 8-3K21 | 9340 | 7860 | 13410 | (2) 15 | 50,3 | (2) 2.2 | 1297 | 2120 | 300 | 12080 | 3651 | 1530 | 2121 | 495 |
| eco-ATWB-E 8-4H21 | 10800 | 9320 | 15290 | (2) 5.5 | 36,2 | (2) 2.2 | 1712 | 2120 | 300 | 13960 | 3841 | 1530 | 2311 | 686 |
| eco-ATWB-E 8-4I21 | 10820 | 9330 | 15300 | (2) 7.5 | 39,9 | (2) 2.2 | 1712 | 2120 | 300 | 13980 | 3841 | 1530 | 2311 | 686 |
| eco-ATWB-E 8-4J21 | 10930 | 9440 | 15410 | (2) 11 | 45,1 | (2) 2.2 | 1712 | 2120 | 300 | 14090 | 3841 | 1530 | 2311 | 686 |
| eco-ATWB-E 8-4K21 | 10990 | 9500 | 15470 | (2) 15 | 48,9 | (2) 2.2 | 1712 | 2120 | 300 | 14140 | 3841 | 1530 | 2311 | 686 |
| eco-ATWB-E 8-5H21 | 12410 | 10930 | 17310 | (2) 5.5 | 35,2 | (2) 2.2 | 2128 | 2120 | 300 | 15980 | 4032 | 1530 | 2502 | 876 |
| eco-ATWB-E 8-5I21 | 12430 | 10940 | 17320 | (2) 7.5 | 38,7 | (2) 2.2 | 2128 | 2120 | 300 | 16000 | 4032 | 1530 | 2502 | 876 |
| eco-ATWB-E 8-5J21 | 12540 | 11050 | 17440 | (2) 11 | 43,7 | (2) 2.2 | 2128 | 2120 | 300 | 16110 | 4032 | 1530 | 2502 | 876 |
| eco-ATWB-E 8-5K21 | 12600 | 11110 | 17490 | (2) 15 | 47,4 | (2) 2.2 | 2128 | 2120 | 300 | 16170 | 4032 | 1530 | 2502 | 876 |
| eco-ATWB-E 8-6H21 | 14090 | 12600 | 19400 | (2) 5.5 | 34,1 | (2) 2.2 | 2543 | 2120 | 300 | 18080 | 4222 | 1530 | 2692 | 1067 |
| eco-ATWB-E 8-6I21 | 14110 | 12620 | 19420 | (2) 7.5 | 37,5 | (2) 2.2 | 2543 | 2120 | 300 | 18090 | 4222 | 1530 | 2692 | 1067 |
| eco-ATWB-E 8-6J21 | 14220 | 12730 | 19530 | (2) 11 | 42,4 | (2) 2.2 | 2543 | 2120 | 300 | 18210 | 4222 | 1530 | 2692 | 1067 |
| eco-ATWB-E 8-6K21 | 14270 | 12780 | 19590 | (2) 15 | 45,9 | (2) 2.2 | 2543 | 2120 | 300 | 18260 | 4222 | 1530 | 2692 | 1067 |

The motors are shipped loose for field mounting

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.




[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.

Coil connections are 4" bevel for welding (BFW)

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E

eco-ATWB-E Models 10-3I12 to 10-6M12

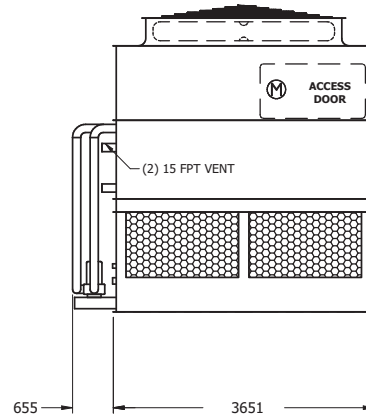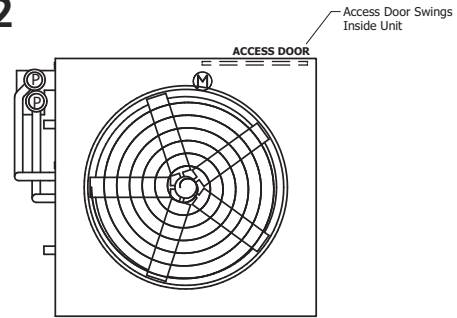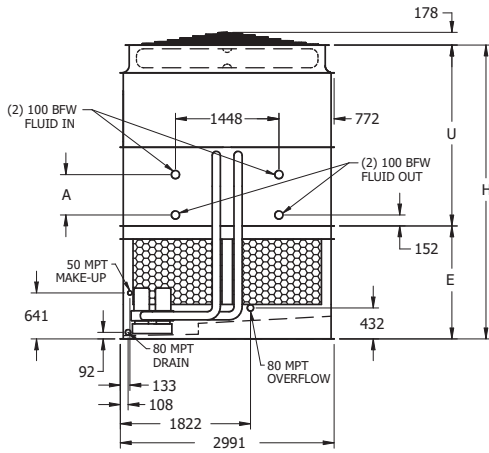

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional **Low & Super Low Sound Fan** execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 10-3I12 | 6790 | 5560 | 10200 | 7,5 | 26,2 | (2) 1.5 | 959 | 1590 | 300 | 8550 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 10-3J12 | 6850 | 5620 | 10260 | 11 | 30,0 | (2) 1.5 | 959 | 1590 | 300 | 8610 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 10-3K12 | 6880 | 5640 | 10290 | 15 | 32,7 | (2) 1.5 | 959 | 1590 | 300 | 8640 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 10-3L12 | 6890 | 5660 | 10300 | 18,5 | 34,8 | (2) 1.5 | 959 | 1590 | 300 | 8650 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 10-3M12 | 6920 | 5680 | 10320 | 22 | 36,6 | (2) 1.5 | 959 | 1590 | 300 | 8680 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 10-4I12 | 7990 | 6750 | 11690 | 7,5 | 25,4 | (2) 1.5 | 1258 | 1590 | 300 | 10040 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 10-4J12 | 8040 | 6810 | 11750 | 11 | 29,1 | (2) 1.5 | 1258 | 1590 | 300 | 10100 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 10-4K12 | 8070 | 6830 | 11780 | 15 | 31,7 | (2) 1.5 | 1258 | 1590 | 300 | 10130 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 10-4L12 | 8080 | 6850 | 11790 | 18,5 | 33,8 | (2) 1.5 | 1258 | 1590 | 300 | 10140 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 10-4M12 | 8110 | 6870 | 11810 | 22 | 35,5 | (2) 1.5 | 1258 | 1590 | 300 | 10170 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 10-5I12 | 9130 | 7890 | 13130 | 7,5 | 24,6 | (2) 1.5 | 1557 | 1590 | 300 | 11490 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 10-5J12 | 9190 | 7950 | 13190 | 11 | 28,2 | (2) 1.5 | 1557 | 1590 | 300 | 11550 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 10-5K12 | 9210 | 7980 | 13220 | 15 | 30,8 | (2) 1.5 | 1557 | 1590 | 300 | 11570 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 10-5L12 | 9230 | 7990 | 13230 | 18,5 | 32,8 | (2) 1.5 | 1557 | 1590 | 300 | 11590 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 10-5M12 | 9250 | 8010 | 13260 | 22 | 34,5 | (2) 1.5 | 1557 | 1590 | 300 | 11610 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 10-6I12 | 10340 | 9100 | 14640 | 7,5 | 23,9 | (2) 1.5 | 1855 | 1590 | 300 | 12990 | 4759 | 1581 | 3178 | 1213 |
| eco-ATWB-E 10-6J12 | 10400 | 9160 | 14700 | 11 | 27,3 | (2) 1.5 | 1855 | 1590 | 300 | 13050 | 4759 | 1581 | 3178 | 1213 |
| eco-ATWB-E 10-6K12 | 10420 | 9190 | 14720 | 15 | 29,8 | (2) 1.5 | 1855 | 1590 | 300 | 13080 | 4759 | 1581 | 3178 | 1213 |
| eco-ATWB-E 10-6L12 | 10440 | 9200 | 14740 | 18,5 | 31,7 | (2) 1.5 | 1855 | 1590 | 300 | 13090 | 4759 | 1581 | 3178 | 1213 |
| eco-ATWB-E 10-6M12 | 10460 | 9220 | 14760 | 22 | 33,4 | (2) 1.5 | 1855 | 1590 | 300 | 13110 | 4759 | 1581 | 3178 | 1213 |

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.

[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.

Coil connections are 4" bevel for welding (BFW)




ENGINEERING

eco-ATWB-E

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E Models 10-3I18 to 10-6N18

ENGINEERING

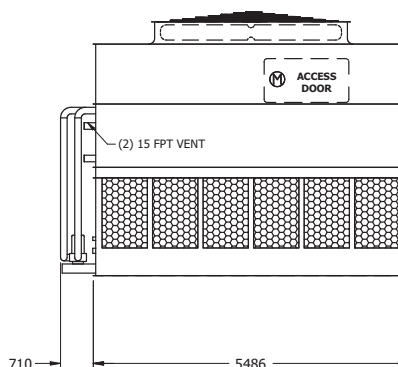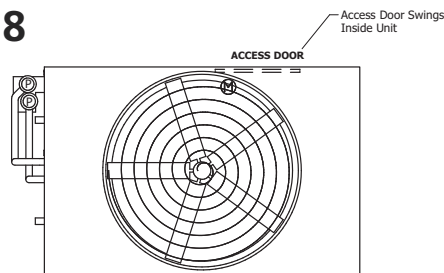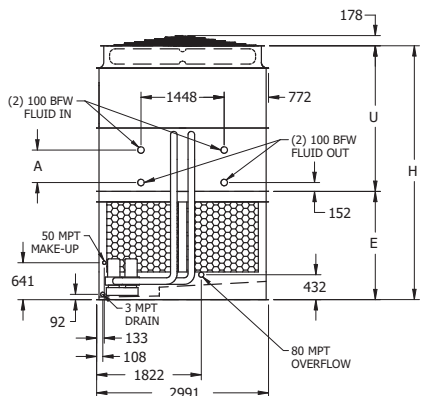

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional **Low & Super Low Sound Fan** execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|------|-------------------|---------------|----------------------|----------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* [*] | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 10-3I18 | 9760 | 7980 | 14870 | 7,5 | 34,4 | (2) 2.2 | 1417 | 2385 | 300 | 12450 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 10-3J18 | 9810 | 8040 | 14930 | 11 | 39,3 | (2) 2.2 | 1417 | 2385 | 300 | 12500 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 10-3K18 | 9840 | 8060 | 14960 | 15 | 43,3 | (2) 2.2 | 1417 | 2385 | 300 | 12530 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 10-3L18 | 9860 | 8080 | 14970 | 18,5 | 46,6 | (2) 2.2 | 1417 | 2385 | 300 | 12550 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 10-3M18 | 9880 | 8100 | 15000 | 22 | 49,1 | (2) 2.2 | 1417 | 2385 | 300 | 12570 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 10-3N18 | 9950 | 8170 | 15070 | 30 | 53,2 | (2) 2.2 | 1417 | 2385 | 300 | 12640 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 10-4I18 | 11540 | 9760 | 17100 | 7,5 | 33,4 | (2) 2.2 | 1868 | 2385 | 300 | 14680 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 10-4J18 | 11600 | 9820 | 17160 | 11 | 38,2 | (2) 2.2 | 1868 | 2385 | 300 | 14740 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 10-4K18 | 11620 | 9840 | 17190 | 15 | 42,0 | (2) 2.2 | 1868 | 2385 | 300 | 14760 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 10-4L18 | 11640 | 9860 | 17200 | 18,5 | 45,3 | (2) 2.2 | 1868 | 2385 | 300 | 14780 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 10-4M18 | 11660 | 9880 | 17230 | 22 | 47,7 | (2) 2.2 | 1868 | 2385 | 300 | 14800 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 10-4N18 | 11730 | 9950 | 17300 | 30 | 51,7 | (2) 2.2 | 1868 | 2385 | 300 | 14870 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 10-5I18 | 13270 | 11490 | 19290 | 7,5 | 32,4 | (2) 2.2 | 2320 | 2385 | 300 | 16870 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 10-5J18 | 13330 | 11550 | 19350 | 11 | 37,1 | (2) 2.2 | 2320 | 2385 | 300 | 16930 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 10-5K18 | 13360 | 11580 | 19380 | 15 | 40,8 | (2) 2.2 | 2320 | 2385 | 300 | 16950 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 10-5L18 | 13370 | 11590 | 19390 | 18,5 | 43,9 | (2) 2.2 | 2320 | 2385 | 300 | 16970 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 10-5M18 | 13400 | 11620 | 19420 | 22 | 46,3 | (2) 2.2 | 2320 | 2385 | 300 | 16990 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 10-5N18 | 13470 | 11690 | 19490 | 30 | 50,1 | (2) 2.2 | 2320 | 2385 | 300 | 17060 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 10-6I18 | 15080 | 13300 | 21550 | 7,5 | 31,4 | (2) 2.2 | 2771 | 2385 | 300 | 19120 | 4759 | 1581 | 3178 | 1213 |
| eco-ATWB-E 10-6J18 | 15140 | 13360 | 21610 | 11 | 35,9 | (2) 2.2 | 2771 | 2385 | 300 | 19180 | 4759 | 1581 | 3178 | 1213 |
| eco-ATWB-E 10-6K18 | 15170 | 13390 | 21640 | 15 | 39,5 | (2) 2.2 | 2771 | 2385 | 300 | 19210 | 4759 | 1581 | 3178 | 1213 |
| eco-ATWB-E 10-6L18 | 15180 | 13400 | 21650 | 18,5 | 42,6 | (2) 2.2 | 2771 | 2385 | 300 | 19220 | 4759 | 1581 | 3178 | 1213 |
| eco-ATWB-E 10-6M18 | 15200 | 13430 | 21670 | 22 | 44,8 | (2) 2.2 | 2771 | 2385 | 300 | 19250 | 4759 | 1581 | 3178 | 1213 |
| eco-ATWB-E 10-6N18 | 15280 | 13500 | 21750 | 30 | 48,6 | (2) 2.2 | 2771 | 2385 | 300 | 19320 | 4759 | 1581 | 3178 | 1213 |

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.



[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.

Coil connections are 4" bevel for welding (BFW)

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E

eco-ATWB-E Models 12-3J12 to 12-6N12

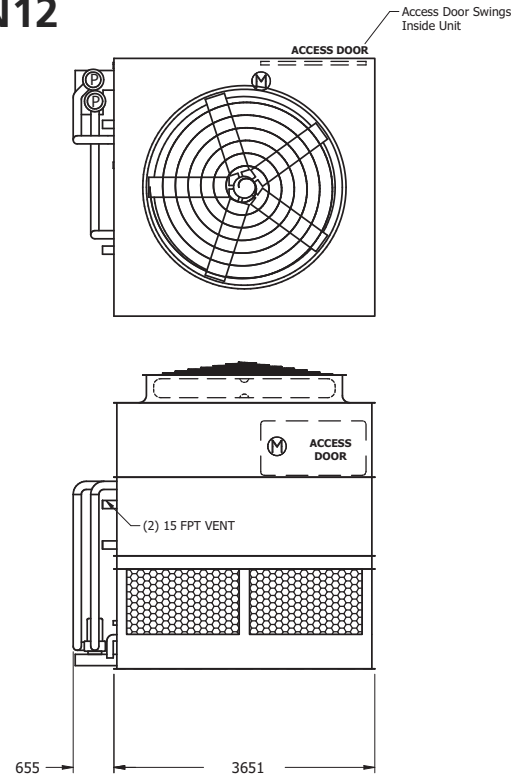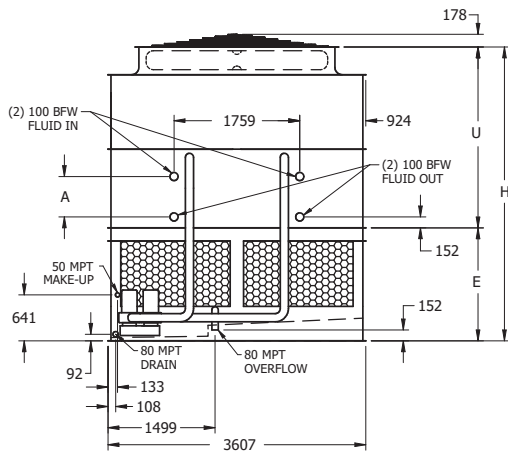

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional **Low & Super Low Sound Fan** execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 12-3J12 | 7900 | 6590 | 11810 | 11 | 34,1 | (2) 1.5 | 1179 | 1855 | 300 | 9990 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 12-3K12 | 7930 | 6620 | 11840 | 15 | 37,5 | (2) 1.5 | 1179 | 1855 | 300 | 10020 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 12-3L12 | 7940 | 6630 | 11850 | 18,5 | 40,0 | (2) 1.5 | 1179 | 1855 | 300 | 10030 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 12-3M12 | 7960 | 6660 | 11870 | 22 | 42,1 | (2) 1.5 | 1179 | 1855 | 300 | 10060 | 4111 | 1581 | 2530 | 565 |
| eco-ATWB-E 12-4J12 | 9370 | 8060 | 13650 | 11 | 33,1 | (2) 1.5 | 1548 | 1855 | 300 | 11830 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 12-4K12 | 9390 | 8080 | 13680 | 15 | 36,4 | (2) 1.5 | 1548 | 1855 | 300 | 11860 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 12-4L12 | 9410 | 8100 | 13690 | 18,5 | 38,8 | (2) 1.5 | 1548 | 1855 | 300 | 11870 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 12-4M12 | 9430 | 8120 | 13710 | 22 | 40,8 | (2) 1.5 | 1548 | 1855 | 300 | 11890 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 12-4N12 | 9500 | 8190 | 13780 | 30 | 44,3 | (2) 1.5 | 1548 | 1855 | 300 | 11960 | 4327 | 1581 | 2746 | 781 |
| eco-ATWB-E 12-5K12 | 10780 | 9480 | 15430 | 15 | 35,3 | (2) 1.5 | 1917 | 1855 | 300 | 13620 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 12-5L12 | 10800 | 9490 | 15450 | 18,5 | 37,6 | (2) 1.5 | 1917 | 1855 | 300 | 13630 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 12-5M12 | 10820 | 9510 | 15470 | 22 | 39,6 | (2) 1.5 | 1917 | 1855 | 300 | 13650 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 12-5N12 | 10890 | 9580 | 15540 | 30 | 42,9 | (2) 1.5 | 1917 | 1855 | 300 | 13720 | 4543 | 1581 | 2962 | 997 |
| eco-ATWB-E 12-6L12 | 12270 | 10960 | 17290 | 18,5 | 36,5 | (2) 1.5 | 2286 | 1855 | 300 | 15470 | 4759 | 1581 | 3178 | 1213 |
| eco-ATWB-E 12-6M12 | 12290 | 10990 | 17310 | 22 | 38,4 | (2) 1.5 | 2286 | 1855 | 300 | 15490 | 4759 | 1581 | 3178 | 1213 |
| eco-ATWB-E 12-6N12 | 12370 | 11060 | 17380 | 30 | 41,6 | (2) 1.5 | 2286 | 1855 | 300 | 15570 | 4759 | 1581 | 3178 | 1213 |

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.

[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.


Coil connections are 4" bevel for welding (BFW)

eco-ATWB-E

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E Models 12-3K14 to 12-6N14

ENGINEERING

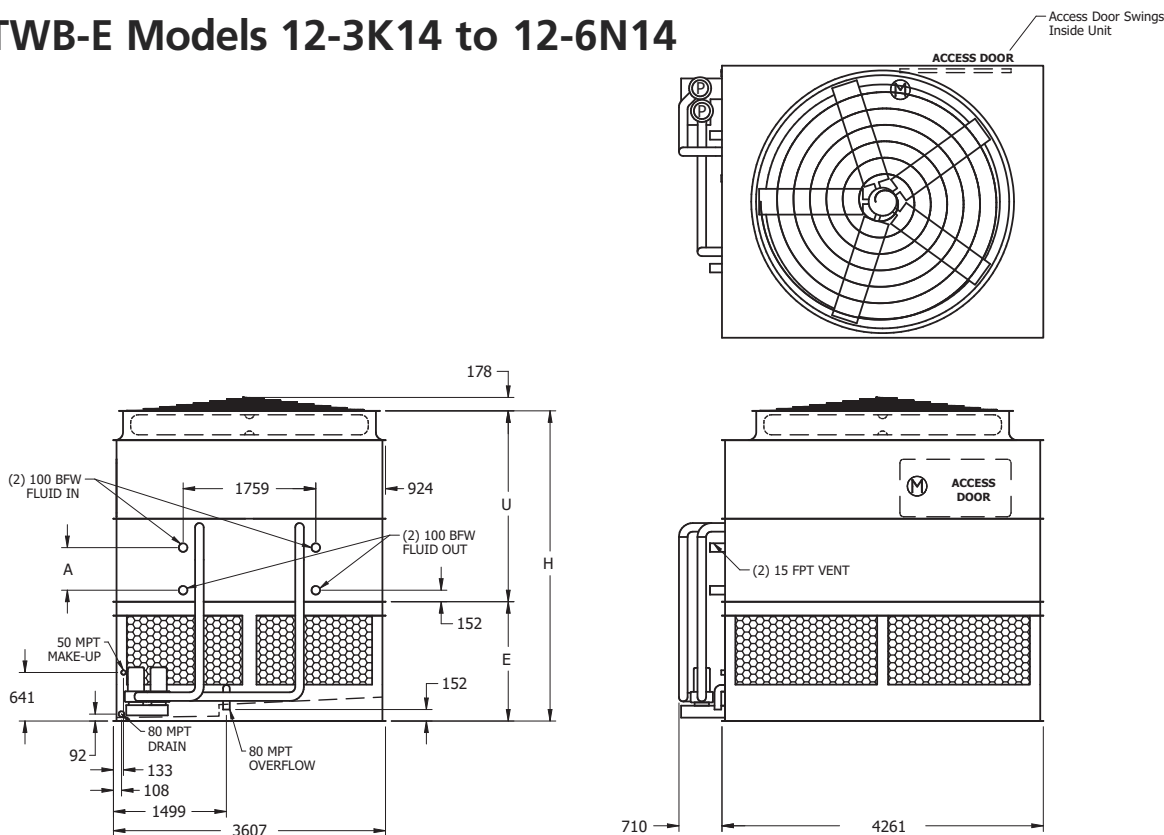

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional **Low & Super Low Sound Fan** execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 12-3K14 | 9040 | 7530 | 13630 | 15 | 41,6 | (2) 2.2 | 1368 | 2160 | 300 | 11500 | 4264 | 1734 | 2530 | 565 |
| eco-ATWB-E 12-3L14 | 9060 | 7540 | 13650 | 18,5 | 44,7 | (2) 2.2 | 1368 | 2160 | 300 | 11510 | 4264 | 1734 | 2530 | 565 |
| eco-ATWB-E 12-3M14 | 9080 | 7570 | 13670 | 22 | 47,0 | (2) 2.2 | 1368 | 2160 | 300 | 11530 | 4264 | 1734 | 2530 | 565 |
| eco-ATWB-E 12-3N14 | 9150 | 7640 | 13740 | 30 | 51,0 | (2) 2.2 | 1368 | 2160 | 300 | 11610 | 4264 | 1734 | 2530 | 565 |
| eco-ATWB-E 12-4K14 | 10750 | 9240 | 15770 | 15 | 40,4 | (2) 2.2 | 1799 | 2160 | 300 | 13640 | 4480 | 1734 | 2746 | 781 |
| eco-ATWB-E 12-4L14 | 10770 | 9250 | 15790 | 18,5 | 43,4 | (2) 2.2 | 1799 | 2160 | 300 | 13650 | 4480 | 1734 | 2746 | 781 |
| eco-ATWB-E 12-4M14 | 10790 | 9270 | 15810 | 22 | 45,6 | (2) 2.2 | 1799 | 2160 | 300 | 13670 | 4480 | 1734 | 2746 | 781 |
| eco-ATWB-E 12-4N14 | 10860 | 9350 | 15880 | 30 | 49,5 | (2) 2.2 | 1799 | 2160 | 300 | 13750 | 4480 | 1734 | 2746 | 781 |
| eco-ATWB-E 12-5L14 | 12370 | 10860 | 17820 | 18,5 | 42,1 | (2) 2.2 | 2231 | 2160 | 300 | 15680 | 4696 | 1734 | 2962 | 997 |
| eco-ATWB-E 12-5M14 | 12390 | 10880 | 17840 | 22 | 44,3 | (2) 2.2 | 2231 | 2160 | 300 | 15710 | 4696 | 1734 | 2962 | 997 |
| eco-ATWB-E 12-5N14 | 12460 | 10950 | 17920 | 30 | 48,0 | (2) 2.2 | 2231 | 2160 | 300 | 15780 | 4696 | 1734 | 2962 | 997 |
| eco-ATWB-E 12-6L14 | 14220 | 12710 | 20100 | 18,5 | 40,8 | (2) 2.2 | 2662 | 2160 | 300 | 17970 | 4912 | 1734 | 3178 | 1213 |
| eco-ATWB-E 12-6M14 | 14240 | 12730 | 20130 | 22 | 42,9 | (2) 2.2 | 2662 | 2160 | 300 | 17990 | 4912 | 1734 | 3178 | 1213 |
| eco-ATWB-E 12-6N14 | 14320 | 12800 | 20200 | 30 | 46,5 | (2) 2.2 | 2662 | 2160 | 300 | 18060 | 4912 | 1734 | 3178 | 1213 |

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.



[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.

Coil connections are 4° bevel for welding (BFW)

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E

eco-ATWB-E Models 12-3K18 to 12-6P18

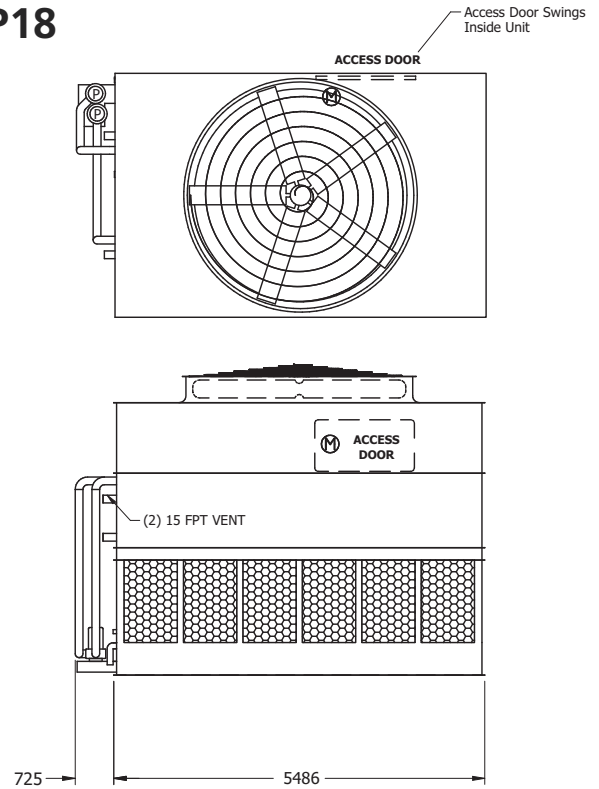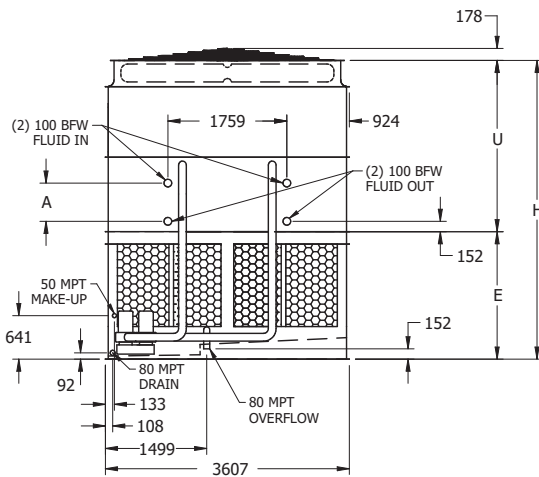

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional **Low & Super Low Sound Fan** execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 12-3K18 | 11410 | 9440 | 17280 | 15 | 50,8 | (2) 4 | 1744 | 2725 | 300 | 14510 | 4416 | 1886 | 2530 | 565 |
| eco-ATWB-E 12-3L18 | 11430 | 9460 | 17300 | 18,5 | 54,7 | (2) 4 | 1744 | 2725 | 300 | 14520 | 4416 | 1886 | 2530 | 565 |
| eco-ATWB-E 12-3M18 | 11450 | 9480 | 17320 | 22 | 58,1 | (2) 4 | 1744 | 2725 | 300 | 14540 | 4416 | 1886 | 2530 | 565 |
| eco-ATWB-E 12-3N18 | 11520 | 9550 | 17390 | 30 | 63,1 | (2) 4 | 1744 | 2725 | 300 | 14620 | 4416 | 1886 | 2530 | 565 |
| eco-ATWB-E 12-4K18 | 13600 | 11630 | 20030 | 15 | 49,3 | (2) 4 | 2302 | 2725 | 300 | 17250 | 4632 | 1886 | 2746 | 781 |
| eco-ATWB-E 12-4L18 | 13610 | 11640 | 20040 | 18,5 | 53,1 | (2) 4 | 2302 | 2725 | 300 | 17260 | 4632 | 1886 | 2746 | 781 |
| eco-ATWB-E 12-4M18 | 13640 | 11670 | 20060 | 22 | 56,4 | (2) 4 | 2302 | 2725 | 300 | 17290 | 4632 | 1886 | 2746 | 781 |
| eco-ATWB-E 12-4N18 | 13710 | 11740 | 20140 | 30 | 61,2 | (2) 4 | 2302 | 2725 | 300 | 17360 | 4632 | 1886 | 2746 | 781 |
| eco-ATWB-E 12-4O18 | 13710 | 11740 | 20140 | 37 | 65,2 | (2) 4 | 2302 | 2725 | 300 | 17360 | 4632 | 1886 | 2746 | 781 |
| eco-ATWB-E 12-5L18 | 15730 | 13760 | 22710 | 18,5 | 51,5 | (2) 4 | 2859 | 2725 | 300 | 19930 | 4848 | 1886 | 2962 | 997 |
| eco-ATWB-E 12-5M18 | 15750 | 13780 | 22730 | 22 | 54,7 | (2) 4 | 2859 | 2725 | 300 | 19950 | 4848 | 1886 | 2962 | 997 |
| eco-ATWB-E 12-5N18 | 15820 | 13850 | 22800 | 30 | 59,4 | (2) 4 | 2859 | 2725 | 300 | 20030 | 4848 | 1886 | 2962 | 997 |
| eco-ATWB-E 12-5O18 | 15830 | 13860 | 22810 | 37 | 63,2 | (2) 4 | 2859 | 2725 | 300 | 20030 | 4848 | 1886 | 2962 | 997 |
| eco-ATWB-E 12-6M18 | 17880 | 15910 | 25420 | 22 | 53,0 | (2) 4 | 3416 | 2725 | 300 | 22650 | 5064 | 1886 | 3178 | 1213 |
| eco-ATWB-E 12-6N18 | 17960 | 15990 | 25500 | 30 | 57,6 | (2) 4 | 3416 | 2725 | 300 | 22720 | 5064 | 1886 | 3178 | 1213 |
| eco-ATWB-E 12-6O18 | 17960 | 15990 | 25500 | 37 | 61,3 | (2) 4 | 3416 | 2725 | 300 | 22720 | 5064 | 1886 | 3178 | 1213 |
| eco-ATWB-E 12-6P18 | 18050 | 16080 | 25590 | 45 | 64,5 | (2) 4 | 3416 | 2725 | 300 | 22810 | 5064 | 1886 | 3178 | 1213 |




[†] Heaviest section is the coil / fan section
^{*} Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).
[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.
[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.
 Coil connections are 4" bevel for welding (BFW)

ENGINEERING

eco-ATWB-E

ENGINEERING DATA & DIMENSIONS

eco-ATWB-E Models 12-3L20 to 12-6P20

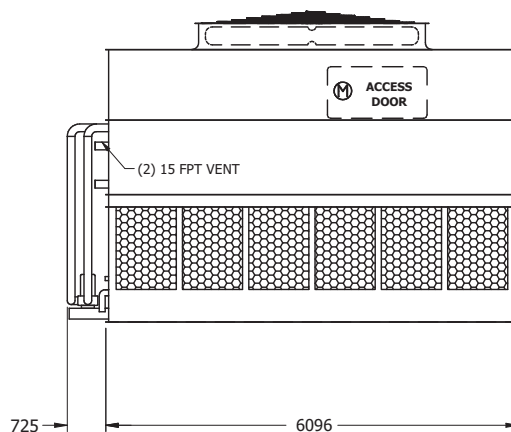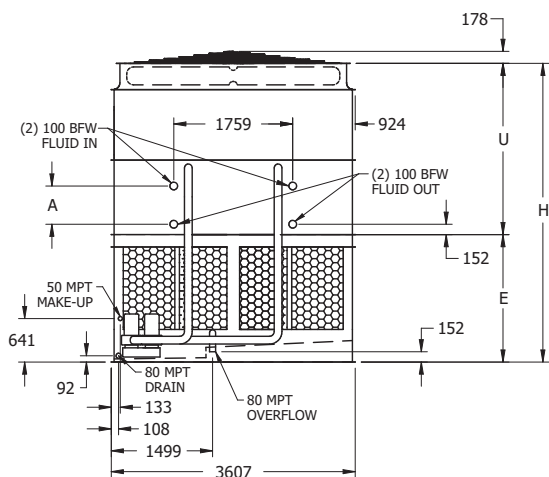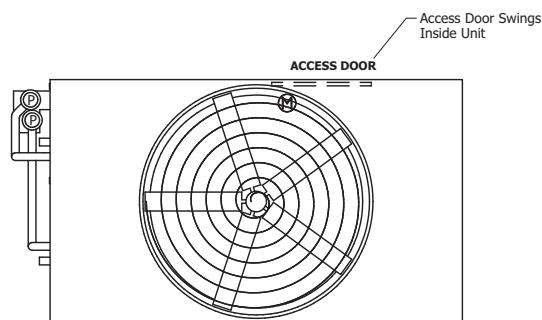

Notes: The number of coil connections doubles when the flow rate exceeds 56 l/s.
For additional Weights and Heights of optional **Low & Super Low Sound Fan** execution, see table on page 43.

| eco-ATWB-E Model Number | Weights (kg) | | | Fans | | Spray Pump kW | Coil Volume (liters) | Remote Sump [△] | | | Dimensions (mm) [▲] | | | |
|-------------------------|--------------|-------------------------------|-----------|------|-------------------|---------------|----------------------|--------------------------|-----------------|-----------------------|------------------------------|---------|---------|--------|
| | Shipping | Heaviest Section [†] | Operating | kW | m ² /s | | | Liters Req'd* | Conn. Size (mm) | Operating Weight (kg) | Height H | Lower E | Upper U | Coil A |
| eco-ATWB-E 12-3L20 | 12520 | 10360 | 19080 | 18,5 | 58,7 | (2) 4 | 1933 | 3030 | 350 | 16020 | 4416 | 1886 | 2530 | 565 |
| eco-ATWB-E 12-3M20 | 12540 | 10390 | 19100 | 22 | 62,4 | (2) 4 | 1933 | 3030 | 350 | 16040 | 4416 | 1886 | 2530 | 565 |
| eco-ATWB-E 12-3N20 | 12610 | 10460 | 19170 | 30 | 68,1 | (2) 4 | 1933 | 3030 | 350 | 16120 | 4416 | 1886 | 2530 | 565 |
| eco-ATWB-E 12-3O20 | 12620 | 10460 | 19180 | 37 | 72,4 | (2) 4 | 1933 | 3030 | 350 | 16120 | 4416 | 1886 | 2530 | 565 |
| eco-ATWB-E 12-4L20 | 14920 | 12770 | 22110 | 18,5 | 57,0 | (2) 4 | 2553 | 3030 | 350 | 19050 | 4632 | 1886 | 2746 | 781 |
| eco-ATWB-E 12-4M20 | 14940 | 12790 | 22130 | 22 | 60,5 | (2) 4 | 2553 | 3030 | 350 | 19070 | 4632 | 1886 | 2746 | 781 |
| eco-ATWB-E 12-4N20 | 15020 | 12870 | 22200 | 30 | 66,1 | (2) 4 | 2553 | 3030 | 350 | 19140 | 4632 | 1886 | 2746 | 781 |
| eco-ATWB-E 12-4O20 | 15020 | 12870 | 22210 | 37 | 70,3 | (2) 4 | 2553 | 3030 | 350 | 19150 | 4632 | 1886 | 2746 | 781 |
| eco-ATWB-E 12-5M20 | 17300 | 15140 | 25100 | 22 | 58,7 | (2) 4 | 3173 | 3030 | 350 | 22050 | 4848 | 1886 | 2962 | 997 |
| eco-ATWB-E 12-5N20 | 17370 | 15220 | 25170 | 30 | 64,1 | (2) 4 | 3173 | 3030 | 350 | 22120 | 4848 | 1886 | 2962 | 997 |
| eco-ATWB-E 12-5O20 | 17370 | 15220 | 25180 | 37 | 68,2 | (2) 4 | 3173 | 3030 | 350 | 22120 | 4848 | 1886 | 2962 | 997 |
| eco-ATWB-E 12-5P20 | 17460 | 15310 | 25270 | 45 | 71,8 | (2) 4 | 3173 | 3030 | 350 | 22210 | 4848 | 1886 | 2962 | 997 |
| eco-ATWB-E 12-6N20 | 19960 | 17810 | 28380 | 30 | 62,1 | (2) 4 | 3792 | 3030 | 350 | 25330 | 5064 | 1886 | 3178 | 1213 |
| eco-ATWB-E 12-6O20 | 19960 | 17810 | 28390 | 37 | 66,1 | (2) 4 | 3792 | 3030 | 350 | 25330 | 5064 | 1886 | 3178 | 1213 |
| eco-ATWB-E 12-6P20 | 20060 | 17900 | 28480 | 45 | 69,6 | (2) 4 | 3792 | 3030 | 350 | 25420 | 5064 | 1886 | 3178 | 1213 |

[†] Heaviest section is the coil / fan section

* Liters shown is water in suspension in unit and piping. Allow for additional water in bottom of remote sump to cover pump suction and strainer during operation. (300mm would normally be sufficient).

[△] When a remote sump arrangement is selected, the spray pump, suction strainer and associated piping are omitted; the unit is provided with an oversized outlet to facilitate drainage to the remote sump.

[▲] Unit dimensions and coil connections may vary slightly from catalog. See factory certified prints for dimensions, quantity of coil connections, and piping configuration.

Coil connections are 4" bevel for welding (BFW)

LOW SOUND & SUPER LOW SOUND FANS ADDITIONAL HEIGHT AND WEIGHT

eco-ATWB-E

| eco-ATWB-E Model No | Low Sound Fan Additional Height (mm) | Super Low Sound Fan | |
|---------------------|--|---------------------------|---------------------------|
| | | Additional Height (mm) | Additional Weight (kg) |
| 9-3G8 to 9-6J8 | 101 | 432 | 70 |
| 8-3G9 to 8-6K9 | 101 | 432 | 60 |
| 8-3H11 to 8-6K11 | 101 | 432 | 60 |
| 8-3H12 to 8-6L12 | 101 | 432 | 60 |
| 8-3I14 to 8-6M14 | 101 | 432 | 60 |
| 8-3G18 to 8-6K18 | 101 | 432 | 120 |
| 8-3H21 to 8-6K21 | 101 | 432 | 120 |
| 10-3I12 to 10-6M12 | 0 | 546 | 320 |
| 10-3I18 to 10-6N18 | 0 | 546 | 320 |
| 12-3J12 to 12-6N12 | 0 | 546 | 320 |
| 12-3K14 to 12-6N14 | 0 | 546 | 320 |
| 12-3K18 to 12-6P18 | 178 | 394 | 550 |
| 12-3L20 to 12-6P20 | 178 | 394 | 550 |

eco-ATWB-E


RECOMMENDED STEEL SUPPORT

ENGINEERING


The recommended support for EVAPCO Closed Circuit Coolers is structural "I" beams located under the outer flanges and running the entire length of the unit. The unit should be elevated to allow access underneath the unit and to the roof below. Mounting holes 19 mm in diameter are located in the bottom flanges of the pan section to provide for bolting to the structural steel. (Refer to certified drawings from the factory for bolt hole locations.)

Beams should be level before setting the unit in place. Do not level the unit by shimming between the unit and the structural steel. Dimensions weights and data are subject to change without notice. Refer to the factory certified drawings for exact dimensions.

Plan Views

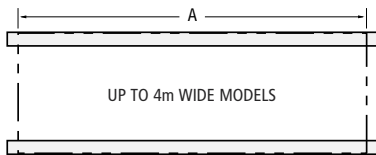

End Elevations



SUPPORTING STEEL DIMENSIONS

| eco-ATWB-E | A | B |
|--------------------|------|------|
| 9-3G8 to 9-6J8 | 2578 | 2283 |
| 8-3G9 to 8-6K9 | 2731 | 2388 |
| 8-3H11 to 8-6K11 | 3188 | 2388 |
| 8-3H12 to 8-6L12 | 3651 | 2388 |
| 8-3I14 to 8-6M14 | 4261 | 2388 |
| 8-3G18 to 8-6K18 | 5486 | 2388 |
| 8-3H21 to 8-6K21 | 6401 | 2388 |
| | A | B |
| 10-3I12 to 10-6M12 | 3651 | 2991 |
| 10-3I18 to 10-6N18 | 5486 | 2991 |
| | A | B |
| 12-3J12 to 12-6N12 | 3651 | 3607 |
| 12-3K14 to 12-6N14 | 4261 | 3607 |
| 12-3K18 to 12-6P18 | 5486 | 3607 |
| 12-3L20 to 12-6P20 | 6096 | 3607 |

SPECIFICATIONS

eco-ATWB-E

FACTORY FABRICATED INDUCED DRAFT eco-ATWB-E CLOSED CIRCUIT COOLER

General

Furnish and install factory assembled closed circuit cooler of induced draft counterflow design with a horizontal multiple side air entry and a vertical air discharge. The unit shall be completely factory assembled and conform to the specifications and schedules.

The closed circuit cooler shall be CTI certified and have the capacity to cool ___ l/s water / glycol from ___°C to ___°C with a ___°C entering wet bulb temperature and a dry bulb switchover temperature of ___°C.

Optional: (If dry operating conditions are different than the wet operating conditions)

Each unit shall also cool ___ l/s of ___ from ___°C to ___°C with a ___°C entering dry bulb temperature.

The total fan power should not exceed ___ kW.
The total pump power should not exceed ___ kW.

The total overall unit dimensions should not exceed the following:

Length: ___ mm Width: ___ mm Height: ___ mm

The maximum operating weight should not exceed ___ kg.

The unit will be delivered in two parts: the bottom basin - louver section and the heat transfer - fan section. The unit (top and bottom section) shall be joined together with elastic sealer and bolted together with corrosion resistant fasteners.

Approved manufacturer Evapco – model eco-ATWB-E _____

Thermal Performance – Performance Warranty

The cooler shall be capable of performing the thermal duties as shown in the schedule and on the drawings, and its design thermal rating shall be certified by the Cooling Technology Institute (C.T.I.) and the Eurovent Certification Company (ECC). Only models with performance certified by CTI and ECC will be approved.

Manufacturers' performance guarantee without ECC-CTI certification for the proposed model or an independent field performance test shall not be accepted.

Applicable Standards

- CTI ATC 128 Test Code for Measurement of Sound from Water Cooling Towers
- CTI STD 201 Standard for Thermal Performance Certification of Evaporative Heat Rejection Equipment.
- Eurovent Rating Standard for Cooling Towers

Submittals

- Shop drawings: submit shop drawings indicating dimensions, weight loadings and required clearances.
- Product data: submit manufacturers technical product data, original selection printouts and clearance requirements.
- Complete noise data sheet for the selected closed circuit cooler(s).
- Maintenance data for the closed circuit cooler(s) and
- The manufacturer shall provide factory test run certificates of the fans and fan motor.

Product Delivery – Storage and Handling

- The contractor shall make the provisions for proper storage at site before installation and handle the product per the instructions of the manufacturer.
- Once installed provide the necessary measures to keep units clean and protected from any dust and mechanical damage.

Quality Assurance

- The manufacturer shall have a quality assurance system in place which is certified by an accredited registrar and complying with the requirements of ISO 9001. This is to guarantee a consistent level of product and service quality.
- Manufacturers without ISO 9001 certification are not acceptable.

Warranty

- The products will be warranted for a period of minimum two (2) years from the date of shipment.

PRODUCT**Construction – Corrosion Resistance**

- The structure and all steel elements of the pan and casing shall be constructed of Z 725 hot dip galvanized steel for long life and durability. Alternatives with lower zinc layer thickness and external paint or coating are not accepted as equal.
- The strainer shall be made of stainless steel type 304.
- During fabrication all panel edges shall be coated with a 95% pure zinc compound.
- Casing materials shall be of non flammable construction only.

OPTIONAL EXECUTION – BASIN IN AISI 304**Construction – Corrosion Resistance**

- The structure and all steel elements of the Basin and Louver section up to the water level shall be made of stainless steel AISI 304.
- Alternatives with hot dip galvanized steel and epoxy coatings in lieu of the stainless steel AISI 304 are not considered to be equal and are not accepted.
- All other steel components of the casing shall be constructed of Z 725 hot dip galvanized steel for long life and durability. Alternatives with lower zinc layer thickness and external paint or coating or FRP materials are not accepted as equal.
- The strainer shall be made of stainless steel AISI 304.
- During fabrication all galvanized steel panel edges shall be coated with a 95% pure zinc compound.
- Casing materials shall be of non flammable construction only.

OPTIONAL EXECUTION – COMPLETE UNIT IN**STAINLESS STEEL AISI 304 (except heat exchange coil(s))****Construction – Corrosion Resistance**

- The structure and all steel elements shall be made of AISI 304.
- Alternatives with hot dip galvanized steel and epoxy coatings in lieu of the AISI 304 are not considered to be equal and are not accepted.
- The strainer shall be made of stainless steel AISI 304.
- Casing materials shall be of non flammable construction only.

Closed Circuit Cooler Basin

- Standard basin accessories include: overflow, drain, strainer and brass make up valve with plastic float ball.
- The strainer shall be made of AISI 304.
- The entire pan area shall incorporate a sloped and stepped basin design to prevent sediment built up, biological film and standing water.
- Upper and lower basin bottoms shall be sloped to provide drainage of the complete basin section.
- The basin can be inspected while the unit is in operation with the fan(s) and pump(s) running.

Air Inlet Louvers

- The air inlet louvers shall be constructed of UV inhibited polyvinyl chloride (PVC), mounted in easily removable frames for easy access to the basin.
- The louvers shall be at four sides to provide easy access to the basin interior.
- The louvers shall have a minimum of two changes in air direction to prevent splash out and block direct sunlight from entering the basin.

eco-ATWB-E

SPECIFICATIONS

- d) The louvers will have a 19 mm opening to prevent debris from entering the basin.

Casing Section

Heat Transfer Coil

- a) The closed circuit cooler shall use internally enhanced heat exchange coils of an elliptical tube design to obtain lower air flow resistance and allow higher water loadings around the tubes. Each row of the heat exchanger coil shall be provided with elliptical spiral fins to increase the evaporative and dry thermal performance of the unit.
- b) The heat transfer coil(s) shall be made of all prime surface, encased in a steel framework and hot dip galvanized after fabrication as a complete assembly.
- c) The tubes shall be arranged in a self spacing, staggered pattern in the direction of air flow for maximum heat transfer efficiency and minimum pressure drop.
- d) The heat exchange coils shall be air pressure tested under water.
- e) The design and manufacturing process shall be approved and in accordance with the "Pressure Equipment Directive" – PED 97 / 23 EC.
- f) The manufacturer shall be responsible for the manufacturing and performance testing of the entire heat transfer coil. This is to assure single source responsibility.
- g) The casing shall totally encase the complete coil section to protect the complete coil from direct atmospheric contact.
- h) The pressure drop of the process fluid through the coil shall not exceed ____kPa.

Water Distribution

- a) The water distribution system shall be completely enclosed and protected from sunlight exposure, environmental elements and debris. Water distribution systems with direct exposure to the environment are not allowed.
- b) The spray header and branches shall be constructed of Schedule 40, Polyvinyl Chloride (PVC) pipe for corrosion resistance.
- c) The water shall be distributed over the coil by precision molded ZM spray nozzles with large minimum orifice openings and integral sludge ring to eliminate clogging.
- d) The nozzles shall be threaded into the water distribution piping to assure positive positioning and easy removal for maintenance. Snap in or strapped on nozzles are not accepted.
- e) Each coil shall have a dedicated recirculation pump and water distribution system, which are completely separated by a water tight partition which begins above the water distribution systems and ends at the basin in order to allow for simultaneous wet and dry operation.

Water Circulation Pumps

- a) The unit will have 2 independent circulation pumps to guarantee the best regulation to reduce water consumption
- b) The pumps shall be a close coupled, centrifugal type with mechanical seal, installed vertically at the factory to allow free drainage on shut down.
- c) 2x ____ kW totally enclosed motors suitable for outdoor service shall be furnished.
- d) The motors shall be suitable for the following power supply: ____volts, ____hertz and ____phase and 2x ____kW.

Drift Eliminators

- a) The drift eliminators shall be constructed of entirely inert polyvinyl (PVC) that has been specially treated to resist ultra violet light.
- b) Assembled in easily handled sections, the eliminator blades shall be spaced on 25 mm centers and shall incorporate three changes in air direction to assure efficient removal of entrained moisture from the discharge air stream.
- c) The maximum drift rate shall not exceed 0,001 % of the circulating water rate.

Access Door

- a) A large hinged access door shall provide access to the fan section for maintenance.

Mechanical Equipment

Axial Propeller Fan(s) (Standard)

- a) Fan shall be heavy duty wide chord axial propeller type, statically balanced and constructed of extruded aluminum alloy blades.
- b) Fans shall be installed in a closely fitted cowl with venturi air inlet for maximum fan efficiency.
- c) The fans shall utilize a soft connect blade to hub design, compatible with variable speed drives, to avoid transmission of vertical forces to the unit structure.
- d) Each fan blade shall be individually adjustable.
- e) The fan cowl shall be covered with a heavy gauge hot dip galvanized steel wire fan guard.
- f) The fan – drive system (fan – drive – motor) shall be factory mounted, adjusted and undergo a trial run in the factory before shipment.

Axial Propeller Fan(s) - Low Sound Fan (Alternative)

- a) Fan shall be heavy duty wide chord axial propeller type, statically balanced and constructed of extruded aluminum alloy blades.
- b) Fans shall be installed in a closely fitted cowl with venturi air inlet for maximum fan efficiency.
- c) The fans shall utilize a soft connect blade to hub design, compatible with variable speed drives, to avoid transmission of vertical forces to the unit structure.
- d) Each fan blade shall be individually adjustable.
- e) The fan cowl shall be covered with a heavy gauge hot dip galvanized steel wire fan guard.
- f) The fan – drive system (fan – drive – motor) shall be factory mounted, adjusted and undergo a trial run in the factory before shipment.

Axial Propeller Fan(s) - Super Low Sound Fan (Alternative)

- a) Fan shall be extremely wide chord axial, one piece heavy duty propeller type, statically balanced and made of FRP.
- b) Fans will be installed in a closely fitted cowl with venturi air inlet for maximum fan efficiency.
- c) The fan cowl shall be covered with a heavy gauge hot dip galvanized steel wire fan guard.
- d) The fan – drive system (fan – drive – motor) shall be factory mounted, adjusted and undergo a trial run in the factory before shipment.
- e) The fans are high efficiency and operate with no loss of thermal performance

Bearings and Drive

- a) The fan shaft (s) shall be supported by heavy duty, self aligning ball type bearings with cast iron housings.
- b) The bearings shall be rated for an L-10 life of 75000 hours.
- c) The fan drive sheaves shall be aluminum alloy.
- d) The belt shall be a multigroove belt system, constructed of neoprene with polyester cords and designed for 150% of the motor nameplate horsepower.
- e) The grease fittings shall be extended to a location just inside the access door.

Motor (2.3 & 2.4 meter wide Models)

- a) The fan motor shall be Totally Enclosed Fan Cooled (TEFC), squirrel cage, ball bearing type motor.
- b) The motor shall be specially designed for cooling tower use with moisture protection on the winding, shaft and bearings.
- c) The motor shall be minimum IP 55 degree of protection, Class F insulation, Service Factor 1 and selected for the appropriate cooling tower duty and the correct ambient temperature but minimum 40°C.
- d) Motors bearings shall be double sealed non-relubricable or external grease nipples shall be provided.
- e) The motor shall be mounted on an adjustable heavy duty steel motor base.
- f) A hinged protective cover shall shield the motor and sheave from the weather.

SPECIFICATIONS

ECO-ATWB-E

- g) The motor power supply shall be ____ volts, ____ hertz and ____ phase.

Motor (3 and 3.6 meter wide Models)

- a) The fan motor shall be Totally Enclosed Air Over (TEAO), squirrel cage, ball bearing type motor.
- b) The motor shall be specially designed for cooling tower use with moisture protection on the windings, shaft and bearings.
- c) The motor shall be minimum IP 55 degree of protection, Class F insulation, Service Factor 1 and selected for the appropriate cooling tower duty and the correct ambient temperature but minimum 40°C.
- d) Motor bearings shall be double sealed non-relubricable or external grease nipples shall be provided.
- e) The motor shall be mounted on an adjustable heavy duty steel motor base.
- f) The motor base shall be able to swing to the outside of the unit for repair or removal.
- g) The motor power supply shall be ____ volts, ____ hertz and ____ phase.

Sound Levels

Sound Level

The maximum sound pressure levels (dB) measured 1.5 m 45° from the top of the closed circuit cooler operating at full fan speed shall not exceed the sound levels detailed below.

| | | | | | | | | | |
|----------|----|-----|-----|-----|------|------|------|------|-------|
| Location | 63 | 125 | 250 | 500 | 1000 | 2000 | 4000 | 8000 | dB(A) |
| | Hz | Hz | Hz | Hz | Hz | Hz | Hz | Hz | Hz |

Fan discharge

Air inlet /end

CONTROLS

Control panel

The unit(s) shall be provided with a control panel which operates by measuring and analyzing water inlet and outlet temperature simultaneous with ambient dry bulb monitoring in order to minimize the evaporative cooling mode of operation and to save system water. The control panel can also be programmed to operate with a water savings or energy savings priority.

The system will include:

A MODBUS 485* Port for the Building Automation System

- Programmable Logic Control
- Fluid Inlet Temperature Sensor(s)
- Fluid Outlet Temperature Sensor(s)
- Basin Temperature Sensor(s)
- Ambient Dry Bulb Sensor(s)
- Variable frequency drive(s) For Fan Motor(s)
- Recirculating Pump Motor Starter(s).
- Main Disconnect
- Manual Bypass
- DC power supply for the PLC and instrumentation.
- Heater Package Controls w/ Contactor with Overload Protection
- Control Power Transformer
- Electronic Water Level Control Package

ACCESSORIES (Optional)

Electric Heaters

- a) The closed circuit cooler cold water basin shall be provided with an electric heater package to prevent freezing of the water in the cold water basin, when the pump is shut down.
- b) The electric heater package includes: electric heater element(s), thermostat and low water level cutoff.
- c) The heaters shall be selected to maintain 4 °C basin water temperature at ____ °C ambient
- d) The heater(s) shall be ____V / ____ phase / ____ Hz electric power supply.

Three Probe Electric Water Level Control Package

- a) The closed circuit cooler manufacturer shall provide an electric water level control package instead of the mechanical float valve arrangement.
- b) The package consist of the following elements :
 - Multiple heavy duty stainless steel 316 static sensors mounted in a stilling chamber outside the unit. Electrodes or sensors mounted inside the unit are not accepted as their operation will be disturbed by the moving water in the basin.
 - An ABS, IP 56 case contains all the contactors for the different level probes and will provide an output signal of a relay for automatic filling and one relay for alarm level.
 - The power supply to the control package is 24 Vac / 230 Vac - ____ Hz .
 - A weather protected solenoid valve (PN16) for the water make up ready for piping to a water supply with pressure between 140 kPa and 340 kPa.

Vibration Switch

- a) A vibration limit switch shall be installed on the mechanical equipment support and wired into the control panel. The purpose of this switch is to interrupt power to the motor in the event of excessive vibration.
- b) The switch shall be adjustable for sensitivity and shall require manual reset.

Vertical Access Ladders

- a) A vertical ladder with safety cage which provide easy access to the water distribution system and drive components shall be provided with the closed circuit cooler(s).
- b) The ladder will be completed with a safety cage for safety purposes.
- c) Ladder safety cage shall meet OSHA - CE - BS requirements.

Service Platform

- a) The closed circuit cooler shall be supplied with an external service platform.
- b) The external service platform will be self supporting and include access ladders to the platform.
- c) The external service platform will be installed in front of the fan access doors.
- d) The platform shall meet OSHA - CE - BS requirements.

Motor Davit


- a) The closed circuit cooler shall be supplied with a motor davit to facilitate the removal of fan motor(s) and fan(s).
- b) The davit and braket are constructed of aluminum and are mounted on the side of the unit.
- c) The fan motor davit ships loose with the unit and is installed in the field.

Water Silencer

- a) The water silencers are located in the falling water area of the cold water basin.
- b) The water silencers will reduce the overall sound levels 4 dB (A) to 7 dB (A) measured at 1.5 m from the side or end of the unit, when the fans are running, and 9 dB (A) to 12 dB (A) when fans are off.
- c) The water silencers are constructed of lightweight PVC sections and can be easily removed for access to the basin area.
- d) The water silencers will have no impact on the unit's thermal performance.



 World Headquarters/
Research and
Development Center

 EVAPCO Manufacturing
Locations

EVAPCO, Inc. - World Headquarters & Research / Development Center

P.O. Box 1300 • Westminster, MD 21158 USA
Ph: +1 410-756-2600 • Fx: +1 410-756-6450 • marketing@evapco.com

North America

EVAPCO, Inc.
World Headquarters
P.O. Box 1300
Westminster, MD 21158 USA
Ph: 410-756-2600 - Fx: 410-756-6450
marketing@evapco.com

EVAPCO East
5151 Allendale Lane
Taneytown, MD 21787 USA
Ph: 410-756-2600 - Fx: 410-756-6450
marketing@evapco.com

EVAPCO Midwest
1723 York Road
Greenup, IL 62428 USA
Ph: 217-923-3431 - Fx: 217-923-3300
evapcomw@evapcomw.com

EVAPCO West
1900 West Almond Avenue
Madera, CA 93637 USA
Ph: 559-673-2207 - Fx: 559-673-2378
contact@evapcowest.com

EVAPCO Iowa
925 Quality Drive
Lake View, IA 51450 USA
Ph: 712-657-3223 - Fx: 712-657-3226

**EVAPCO Iowa
Sales & Engineering**
215 1st Street, NE
P.O. Box 88
Medford, MN 55049 USA
Ph: 507-446-8005 - Fx: 507-446-8239
evapcomn@evapcomn.com

EVAPCO Newton
701 East Jourdan Street
Newton, IL 62448 USA
Ph: 618-783-3433 - Fx: 618-783-3499
evapcomw@evapcomw.com

EVAPCOLD
521 Evapco Drive
Greenup, IL 62428 USA
Ph: 217-923-3431
evapcomw@evapcomw.com

EVAPCO-Dry Cooling, Inc.
981 US Highway 22 West
Bridgewater, NJ 08807 USA
Ph: 1-908-379-2665
info@evapco-blct.com

**Refrigeration Valves &
Systems Corporation**
A wholly owned subsidiary of EVAPCO, Inc.
1520 Crosswind Dr.
Bryan, TX 77808 USA
Ph: 979-778-0095 - Fx: 979-778-0030
rvs@rvscorp.com

Evapco Northwest
5775 S.W. Jean Road, Suite 104
Lake Oswego, OR 97035 USA
Ph: 503-639-2137 - Fx: 503-639-1800

EvapTech, Inc.
A wholly owned subsidiary of EVAPCO, Inc.
8331 Nieman Road
Lenexa, KS 66214 USA
Ph: 913-322-5165 - Fx: 913-322-5166
marketing@evaptechinc.com

Tower Components, Inc.
A wholly owned subsidiary of EVAPCO, Inc.
5960 US HWY 64E
Ramseur, NC 27316
Ph: 336-824-2102 - Fx: 336-824-2190
mail@towercomponentsinc.com

South America

**Evapco Brasil
Equipamentos Industriais Ltda**
Rua Alexandre Dumas 1601
04717-004 Sao Paulo - SP - Brazil
Ph: (55) 11-5184-0067

Europe

**EVAPCO Europe BVBA
European Headquarters**
Heersterveldweg 19, Industrieterrein Oost
3700 Tongeren, Belgium
Ph: (32) 12-395029 - Fx: (32) 12-238527
evapco.europe@evapco.be

EVAPCO Europe, S.r.l.
Via Ciro Menotti 10
I-20017 Passirana di Rho, Milan, Italy
Ph: (39) 02-939-9041 - Fx: (39) 02-935-00840
evapcoeuropa@evapco.it

EVAPCO Europe, S.r.l.
Via Dosso 2 - 23020 Piateda Sondrio, Italy

EVAPCO Europe, GmbH
Insterburger Straße, 18
D-40670 Meerbusch, Germany
Ph: (49) 2159-69560 - Fx: (49) 2159-695611
info@evapco.de

EVAPCO Middle East DMCC
Reef Tower, 29th Level, Cluster O,
Jumeirah Lake Towers, P.O. Box 5003310
Dubai, United Arab Emirates
Ph: (971) 4448-7242 - Fx: (971) 4448-7112
info@evapco.ae

EVAPCO Air Solutions a/s
A wholly owned subsidiary of EVAPCO, Inc.
Knøsgårdvej 115, 9440 Aabybro, Denmark
Ph: (45) 9824-4999 - Fx: (45) 9824-4990
flexcoil@flexcoil.dk

EVAPCO S.A. (Pty) Ltd.
A licensed manufacturer of Evapco, Inc.
18 Quality Rd, Isando 1600, Rep. of S. Africa
Ph: (27) 11 392-6630 - Fx: (27) 11-392-6615
evapco@evapco.co.za

Evap Egypt Engineering Industries Co.
A licensed manufacturer of Evapco, Inc.
5 Al Nasr Road St., Nasr City, Cairo, Egypt
Ph: (20) 2-24022866 / (20) 2-24044997/8
Fx: (20) 2-404-4667/ Mob: (20) 12-3917979
primacool@link.net / shady@primacool.net

Asia/Pacific

**EVAPCO China
Asia/Pacific Headquarters**
1159 Luoning Rd. Baoshan Industrial Zone
Shanghai, P. R. China, Postal Code: 200949
Ph: (86) 21-6687-7786 - Fx: (86) 21-6687-7008
marketing@evapcochina.com

**Evapco (Shanghai) Refrigeration
Equipment Co., Ltd.**
1159 Luoning Rd., Baoshan Industrial Zone
Shanghai, P.R. China, Postal Code: 200949
Ph: (86) 21-6687-7786 - Fx: (86) 21-6687-7008
marketing@evapcochina.com

**Beijing EVAPCO Refrigeration
Equipment Co., Ltd.**
Yan Qi Industrial Development District
Huai Rou County
Beijing, P.R. China, Postal Code: 101407
Ph: (86) 10 6166-7238 - Fx: (86) 10 6166-7395
evapcobj@evapcochina.com

EVAPCO Australia Pty Ltd.
34-42 Melbourne Road - P.O. Box 436
Riverstone, N.S.W. Australia 2765
Ph: (61) 29 627-3322 - Fx: (61) 29 627-1715
sales@evapco.com.au

EvapTech Composites Sdn. Bhd
No. 70 (Lot 1289) Jalan Industri 2/3
Rawang Integrated Industrial Park
Rawang, Selangor, 48000 Malaysia
Ph: 60 3 6092-2209 - Fx: 60 3 6092-2210

EvapTech Asia Pacific Sdn. Bhd
A wholly owned subsidiary of EvapTech, Inc.
IOI Business Park, 2/F Unit 20
Persiaran Puchong Jaya Selatan
Bandar Puchong Jaya,
47170 Puchong, Selangor, Malaysia
Ph: +(60-3) 8070 7255 - Fx: +(60-3) 8070 5731
marketing-ap@evaptech.com



EVAPCO... Specialists in Heat Transfer Products and Services.
Visit EVAPCO's Websites at: www.evapco.eu / www.mrgoodtower.eu

